

Technical Bulletin

FR-G05-Z 0751 - 1801_201809_EN HFC R513A
ELCA_Engine ver.4.0.5.0



FR-G05-Z 0751 - 1801


140-396 kW

Chiller, air source for outdoor installation



(The photo of the unit is indicative and may vary depending on the model)

- LOW GWP REFRIGERANT
- HIGH EFFICIENCY
- COMPACTNESS
- EXTREMELY SILENT OPERATION
- FLEXIBILITY
- WIDE OPERATING RANGE
- ALUMINIUM MICRO-CHANNEL HEAT EXCHANGERS
- INTEGRATED HYDRONIC GROUP

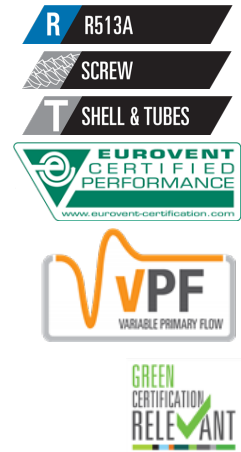

CERTIFICATIONS

Product certifications



Voluntary product certifications




Check ongoing validity of certificate:

www.eurovent-certification.com

or

www.certiflash.com



System certifications



mitsubishi electric hydronics & it cooling systems s.p.a.

Quality System complying with the requirements of UNI EN ISO 9001:2008 regulation
Environmental Management System complying with the requirements of UNI EN ISO 14001:2004 regulation
Occupational Health and Safety Management System complying with the requirements of BS OHSAS 18001:2007



1.1	PRODUCT PRESENTATION	pg.1.1.1 / 1.1.4
2.1	UNIT STANDARD COMPOSITION	pg.2.1.1 / 2.1.4
3.1	ACCESSORIES	pg.3.1.1 / 3.1.14
4.1	GENERAL TECHNICAL DATA	pg.4.1.1 / 4.1.3
5.1	OPERATING LIMITS	pg.5.1.1 / 5.1.4
6.1	HYDRAULIC DATA	pg.6.1.1 / 6.1.2
7.1	ELECTRICAL DATA	pg.7.1.1 / 7.1.3
8.1	FULL LOAD SOUND LEVEL	pg.8.1.1 / 8.1.2
9.1	DIMENSIONAL DRAWINGS	pg.9.1.1 / 9.1.4
10.1	HYDRONIC GROUP	pg.10.1.1 / 10.1.14

Liability disclaimer

The present publication is drawn up by of information only and does not constitute an offer binding upon Mitsubishi Electric Hydronics & IT Cooling Systems S.p.A.

Mitsubishi Electric Hydronics & IT Cooling Systems S.p.A. has compiled the content of this publication to the best of its knowledge. The data contained herein are subject to change without notice. Mitsubishi Electric Hydronics & IT Cooling Systems S.p.A. explicitly rejects any liability for any direct or indirect damage, in the broadest sense, arising from or related to the use and/or interpretation of this publication. All content is copyrighted by Mitsubishi Electric Hydronics & IT Cooling Systems S.p.A.

The units highlighted in this publication contain R513A [GWP₁₀₀ 631] fluorinated greenhouse gases.



Functions



Cooling

Refrigerant



R513A

Compressors



Screw compressor

Fan



Axial fan

Exchangers



Shell & Tubes

Other features



Eurovent



VPF



GREEN Certification relevant

1.1 PRODUCT PRESENTATION

GREEN CERTIFICATION RELEVANT

Mitsubishi Electric Hydronics & IT Cooling Systems S.p.A., as a major player in the world HVAC market and a leading manufacturer of energy efficient, sustainable HVAC solutions, recognizes and supports the diffusion of green certification systems, as an effective way to deliver high performance buildings and improve the quality and the sustainability of the built environment.

Since the first certification system was introduced at the beginning of the 1990s, the demand for certified buildings has grown considerably, as well as the number of standards, rating and certification programs. Operating worldwide Mitsubishi Electric Hydronics & IT Cooling Systems S.p.A., has extensive experience with many of them and is active member of Green Building Council Italy.


Mitsubishi Electric Hydronics & IT Cooling Systems S.p.A., commitment to develop responsible and sustainable HVAC solutions, is reflected by a full range of premium efficiency products and systems, designed with special care to improve building energy performance ratings, according to major certification protocols, including LEED, BREAM, GREENSTAR, BCA, NABERS, DNGB, HQE and BEAM.

To find out more about how our products contribute to enhanced green certification rating and energy performance of a building, please refer to:

<https://www.melcohit.com/GLOBAL/Company/Green-Certifications/QR%20code/>



FR - G05 - Z / R / SL-K 1801

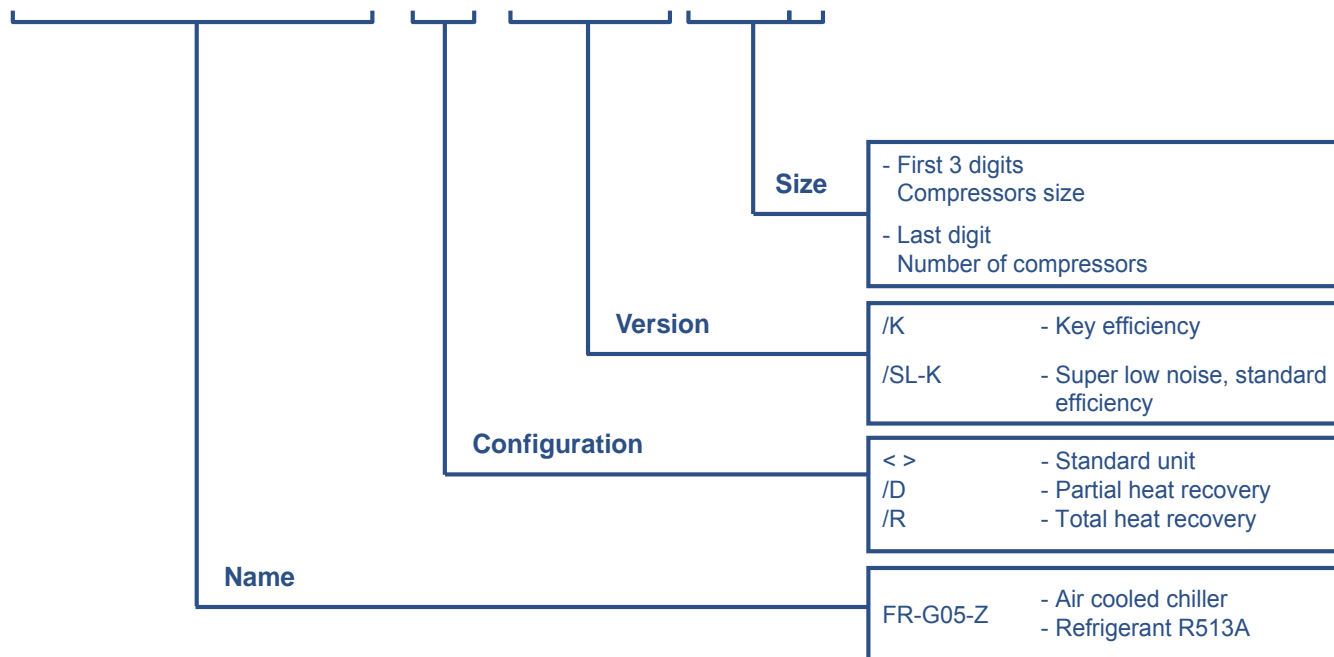

PRODUCT PRESENTATION

Outdoor unit for the production of chilled water with semi-hermetic screw compressor optimized for R513A, axial-flow fans, micro-channel full-aluminum condensing coils, single-pass shell and tubes evaporator designed by Mitsubishi Electric Hydronics & IT Cooling Systems S.p.A. (brazed plate evaporator for sizes 0751 and 0851) and electronic expansion valve.

Base and supporting structure and panels are of galvanized epoxy powder coated steel with increased thickness. Eurovent certification.

Flexible and reliable unit; it easily adapts itself to different thermal load conditions thanks to the precise thermoregulation and the accurate sizing of all internal components. The compressors feature an enhanced lubrication system, an innovative internal geometry and a different control of capacity steps. Innovations that grant a remarkable performance improvement especially at partial loads.

1.3 LOW GWP REFRIGERANT

New generation refrigerant R513A, with reduced greenhouse effect in comparison with traditional HFC refrigerants (Global Warming Potential GWP of R513A = 572, GWP of R134a = 1300 as per IPCC rev. 5th) and zero impact on the ozone layer. Not flammable (ASHRAE 34, ISO 817: class A1).

1.4 HIGH EFFICIENCY

Very high efficiency at full and partial load, at the highest market levels, thanks to the adopted technological solutions. These units ensure low operating costs and therefore a quick payback time.

1.5 COMPACTNESS

Compactness in terms of overall size and weight, helping installation and working on site

1.6 EXTREMELY SILENT OPERATION

As the result of a systematic design oriented to minimize the noise level, the silenced version units give the best combination of quietness and efficiency on the market.

1.7 FLEXIBILITY

Flexibility in the applications thanks to the many configurations and versions available.

1.8 WIDE OPERATING RANGE

The accurate condensation control (variable fan speed regulation as per standard on every model) and devoted kits allow unit's operation from -10°C (-20°C with accessories) to 46°C (50°C with accessories) of outdoor air temperature and from -8°C to 18°C (20°C with accessories) of evaporator leaving water temperature.

1.9 ALUMINIUM MICRO-CHANNEL HEAT EXCHANGERS

The full aluminium micro-channel condenser coils deliver high efficiency whilst ensuring a reduced refrigerant volume and a lower unit weight. The e-coating protection (optional) grants the highest level of resistance to corrosion in any condition, even in the most aggressive environments.


1.10 INTEGRATED HYDRONIC GROUP

The built-in hydronic group (optional) includes the main water circuit components. It is available with 1 or 2 pumps, fixed or variable speed, high or low head to satisfy all the different industrial and comfort application requirements.

2.1 UNIT STANDARD COMPOSITION

CONFIGURATIONS


- , standard unit

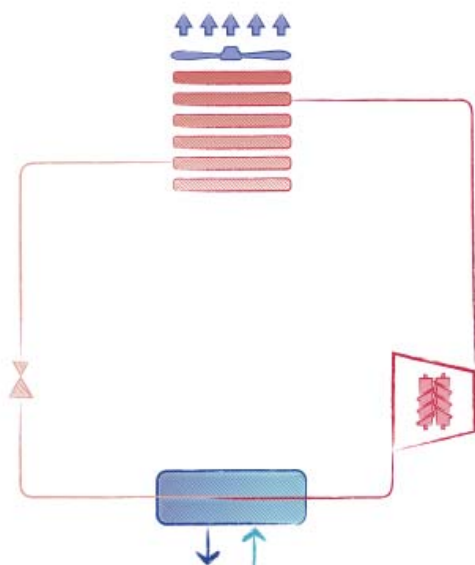


No heat recovery is possible.

/D, unit with partial heat recovery

Heat recovery: ON

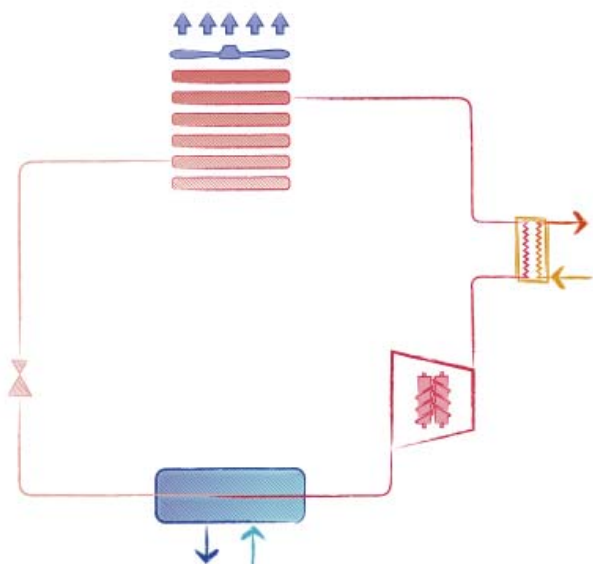

Heat recovery: OFF (water flow stopped)

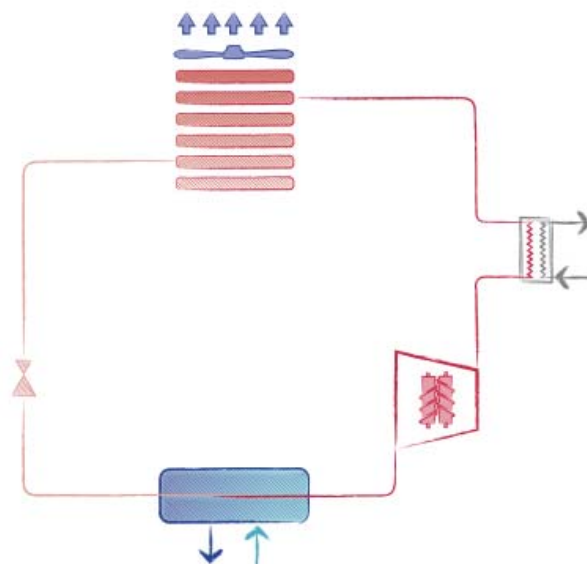

Each refrigerant circuit is fitted with a desuperheater.

The superheating heat recovery is only possible when the temperature of the hot water circuit is lower than the compressor discharge temperature. The heat recovery and its amount depends on the unit's operating conditions, in particular the outdoor air temperature and the load percentage. It is advised to interrupt the water flow to the desuperheater when the conditions for an actual heat recovery are not met.

The smart management of the desuperheater pump(s) is possible with the option 3371 D - RELAY 1 PUMP (ON/OFF), further information is available in the bulletin section dedicated to accessories.


UNIT STANDARD COMPOSITION

Partial heat recovery operating limits:


	MIN temperature	MAX temperature
Inlet water	25°C (77°F)	56°C (132,8°F)
Outlet water	30°C (86°F)	60°C (140°F)

/R, unit with total heat recovery

Heat recovery: ON

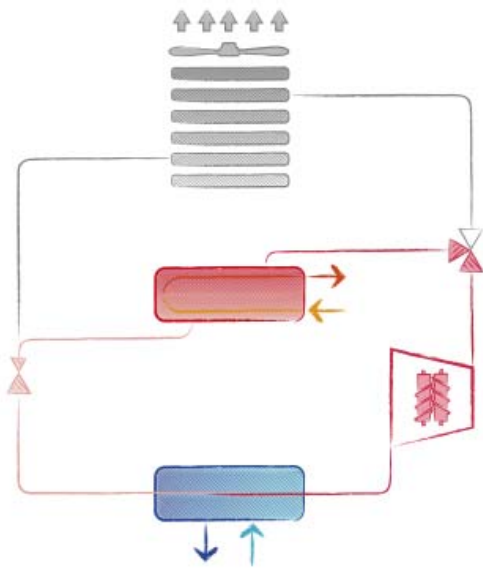

Heat recovery: OFF

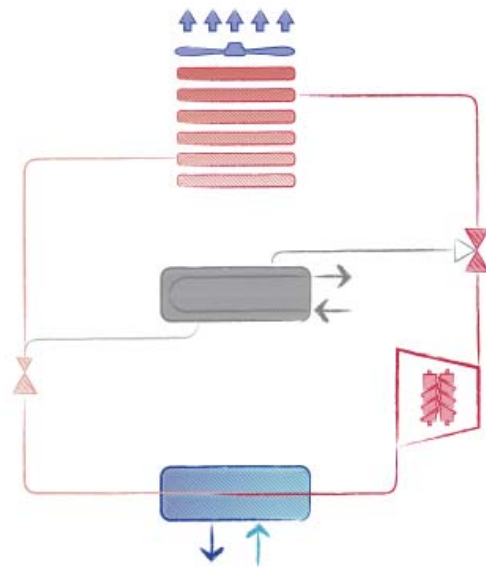

Each refrigerant circuit is fitted with a total heat recovery exchanger.

The heat recovery mode is managed according to the hot water temperature set-point.

When the heat recovery mode is active, the condensation takes place in the devoted refrigerant/water heat exchanger instead of in the finned coils.

The available hydronic modules and primary flow control options for the total heat recovery exchanger are listed in the bulletin section dedicated to accessories.

Total heat recovery operating limits:

	MIN temperature	MAX temperature
Inlet water	18°C (64,4°F)	51°C (123,8°F) With Kit HT*: 56°C (132,8°F)
Outlet water	26°C (78,8°F)	55°C (131°F) With Kit HT*: 60°C (140°F)

* Option Kit HT, code 1955.

UNIT STANDARD COMPOSITION

2.2 Chiller, air source for outdoor installation

Outdoor unit for the production of chilled water with semi-hermetic screw compressor optimized for R513A, axial-flow fans, micro-channel full-aluminum condensing coils, single-pass shell and tubes evaporator designed by Mitsubishi Electric Hydronics & IT Cooling Systems S.p.A. (braze plate evaporator for sizes 0751 and 0851) and electronic expansion valve.

Base and supporting structure and panels are of galvanized epoxy powder coated steel with increased thickness. Eurovent certification.

Flexible and reliable unit; it easily adapts itself to different thermal load conditions thanks to the precise thermoregulation and the accurate sizing of all internal components. The compressors feature an enhanced lubrication system, an innovative internal geometry and a different control of capacity steps. Innovations that grant a remarkable performance improvement especially at partial loads.

2.3 Installation note

The unit is supplied fully refrigerant charged and factory tested. On site installation only requires power and hydraulic connection.

2.4 Structure

Structure specifically designed for outdoor installation. Base and frame in hot-galvanized steel sheet of suitable thickness. All parts polyester-powder painted to assure total weather resistance. Painting: RAL 7035 textured finish.

2.5 Refrigerant circuit

Unit designed with one refrigerant circuit and one compressor. In addition to the main components described in the following sections, the refrigerant circuit is fitted as standard with:

- electronic expansion valve
- high and low pressure transducers
- visualization of the pressure's level directly from the controller's interface
- safety switching device for limiting the pressure
- high and low pressure safety valve
- liquid line shut-off device (function performed by electronic expansion valve with ultracap)
- non -return valve in compressor's discharge line integrated in the compressor
- compressor's discharge valve
- liquid line shut-off valve
- refrigerant line sight glass with humidity indicator
- drier filter with replaceable cartridge
- economizer on the following models:
0961 (K, SL-K); 1421 (K; SL-K); 1431 (K; SL-K)

2.6 Compressor

CSC screw-compressors designed according to Mitsubishi Electric Hydronics & IT Cooling Systems S.p.A. specifications and for its exclusive use.

Semi-hermetic screw compressors with 2 five- and six-lobe rotors: the five-lobe rotor is splined directly onto the motor (nominal speed 2950 rpm) without the use of interposed gears.


The bearings provided along the rotor axis are housed in a separate chamber, isolated from the compression chamber. Made of carbon steel, the bearings are granted for a lifetime of 150.000 hours.

Each compressor is provided with an inlet for refrigerant injection (for the extension of operating limits) and the use of the economizer (for the output capacity and efficiency's increase).

Optimized lubrication guarantees oil's distribution between mechanical parts, without using an oil pump. The innovative oil management valve greatly enhances the lubrication system by reducing the oil quantity and allowing a remarkable increase of the compressor efficiency at partial load. The built-in oil separator has 3 stages of separation, and a 10 mm stainless steel mesh filter ensures the constant presence of oil inside.

Innovative mechanic design with inner slider, managed according to specific proprietary parameters, for the variation of V_i depending on the different operating conditions. This allows to adjust the cooling capacity of the compressor from 100% to 40% (data referred to the operating conditions: 7°C of leaving water temperature, 35°C of outdoor air temperature) always achieving maximum efficiency, even in case of considerable load partialization.

The two pole motors are fitted as standard with electric devices to limit the absorbed current during compressor start-up, and with empty start-up. Each compressor is fitted with manual-reset motor thermal protection, delivery gas temperature and oil level controls and an electric resistance for the carter's heating while the compressor is stopped. A check valve fitted on the refrigerant delivery line prevents the rotors from reversing after stopping. On-off cocks on the delivery line of each compressor to isolate the refrigerant charge in the heat exchanger when required.

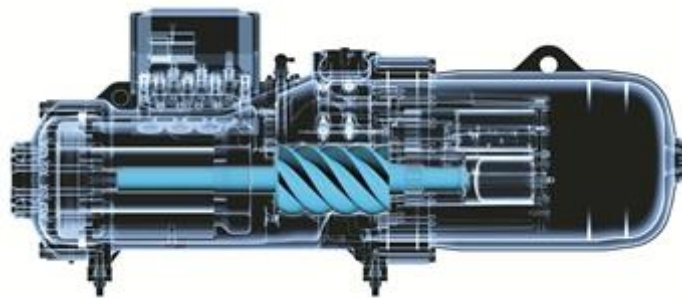

2.7 Plant side heat exchanger

Sizes: 0751; 0851

Braze welded AISI 316 steel plate heat exchanger.

Sizes: 0951; 0961; 1101; 1301; 1401; 1421; 1431; 1801

Dry expansion type shell and tube heat exchanger; it acts as an evaporator with refrigerant flow inside the pipes and water flow on the shell side. Fully developed and manufactured by Mitsubishi Electric Hydronics & IT Cooling Systems S.p.A., the heat exchanger is a single pass type to provide almost perfect countercurrent heat exchange. The water flow on the shell side is fitted with baffles to increase turbulence and therefore the efficiency of exchange. The shell is made of steel, the tube nest is manufactured using copper tubes with internal grooves to improve heat exchange and each pipe is mechanically expanded onto the tube plates.

External insulation: the lining is made of flexible closed cells elastomeric foam (thermal conductivity 0.033W/mK at 0°C) coupled with 3 mm layer of crosslinked PE foam with a surface film of embossed PE for a total thickness of 9 mm.

Antifreeze control: the heat exchanger is fitted with a differential pressure switch which controls the presence of a sufficient water flow when the unit is working, in this way preventing the formation of ice inside; when pumps stop, the antifreeze control is up to an electrical resistance.

Certifications: the heat exchanger is compliant with PED requisites, for pressure equipment. Upon request, the heat exchanger can be supplied AS1210 compliant or with the SafeWork NSW certificate, depending on the size.

2.8 Source side heat exchanger

Microchannel coils ideally positioned on a "V" block structure to optimize airflow and heat transfer. Made entirely in aluminum, the coils are not subjected to galvanic corrosion.

Fins and manifolds are made of aluminum AA3003 while the channels are made of a new aluminum alloy so defined Long Life Alloy (LLA). LLA alloy has a very fine grain microstructure that guarantees higher mechanical properties and a higher resistance to the inter-granular corrosion.

Channel small section favor refrigerant fluid turbulence, which enhances the heat exchange. Tube geometry maximize the surface touched by the air, thus allowing compact dimension and refrigerant charge reduction.

2.9 Fan section source side

Axial electric fans, protected to IP 54 and with insulation class 'F', featuring an external rotor and profiled blades. Housed in an aerodynamic hood complete with safety guard. The fan + outlet set satisfies the efficiency requirements provided for by EcoDesign directive 327/11.

6-pole electric motor with built-in thermal protection. Variable Speed Device (DVVF) for controlling condensation by adjusting the speed of rotation with voltage steps (auto-transformer), fitted with a ventilation distribution system in case of external air low temperature. In conformity with the adjustment logic, each condenser circuit has a totally independent ventilation system.

2.10 Super Low noise version features

The Super Low noise units (version SL-K) feature:

- Condensing section larger than the corresponding standard version's one (only some sizes)
- Reduced fan speed (the speed is automatically increased in case of particularly tough environmental conditions).
- Compressor enclosure with a special soundproofing insulation (multilayer lining of polyurethane foam and sound-insulating gaiter, total thickness 30 mm)
- Covering of the exposed pipes between the V-blocks with painted metal sheets with a special soundproofing insulation (multilayer lining of polyurethane foam and sound-insulating gaiter, total thickness 30 mm)
- If the hydronic is present, the pump enclosure is acoustically insulated by a 30 mm thick lining of polyester fibres (Fiberform)

UNIT STANDARD COMPOSITION

2.11 Electrical and control panel

Electrical and control panel built to EN60204-1 and EC204-1 standards, complete with:

- general door lock isolator
- control circuit transformer
- IP44 XW protection
- power circuit with electric bus bar distribution system
- spring-type control circuit terminal board
- forced ventilation of the electrical board
- phases sequence control
- relays for voltage monitoring
- fuses and contactors for compressors and fans
- compressors protection with internal thermal overload
- electronic controller
- remote ON/OFF terminals
- terminals for cumulative alarm block
- Power supply 400V/3ph/50Hz
- Part-winding compressor start-up for sizes from 0751 to 0961 versions K, SL-K. Star-delta start-up for all other sizes.

2.12 Certification and applicable directives

The unit complies with the following directives and relative amendments:

- EUROVENT Certification program
- CE Declaration of conformity certificate for the European Union
- EAC Product quality certificate for Russian Federation
- M&I Product quality certificate for Australia and New Zealand
- Machine directive 2006/42/EC
- PED Directive 2014/68/EC
- Low Voltage directive 2006/95/EC
- ElectroMagnetic compatibility directive 2004/108/EC
- ErP Directive 2009/125/EC
- ISO 9001 Company's Quality Management System certification
- ISO 14001 Company's Environmental Management System certification

2.13 Tests

Tests performed throughout the production process, as indicated in ISO9001.

Performance or noise tests can be performed by highly qualified staff in the presence of customers.

Performance tests comprise the measurement of:

- electrical data
- water flow rates
- working temperatures
- power input
- power output
- pressure drops on the water-side exchanger both at full load (at the conditions of selection and at the most critical conditions for the condenser) and at part load conditions.

During performance testing it is also possible to simulate the main alarm states.

Noise tests are performed to check noise emissions according to ISO9614.

2.14 Electronic control W3000 TE

The W3000TE controller offers advanced functions and algorithms.

KIPLink - Keyboard In Your Pocket - is the innovative user interface based on WiFi technology that allows one to operate on the unit directly from the smartphone or tablet. Using KIPLink, it is possible to turn the unit on and off, adjust the set-point, plot the main operating variables, monitor in detail the status of the refrigerant circuits, the compressors, the fans and the pumps (if present) and display and reset the possible alarms. In addition to or as an alternative, the Touch interface, with a 7" WVGA colour display and a front USB port, or the Large keyboard, with a wide LCD display and led icons, are available. The temperature control is characterized by the continuous capacity modulation, based on PID algorithms with dynamic neutral zone related to the leaving water temperature. The diagnostics comprises a complete alarm management system, with the "black-box" (via PC) and the alarm history display (via user interface or also PC) for enhanced analysis of the unit operation.

Optional proprietary devices can perform the adjustment of the resources in systems made of several units. Consumption metering and performance measurement are possible as well. Supervision can be easily developed via proprietary devices or the integration in third party systems by means of the most common protocols as ModBus, Bacnet, Bacnet-over-IP, LonWorks. Compatibility with the remote keyboard (up to 8 units). The programmable timer manages a weekly schedule organized into time bands to optimise unit performance by minimising power consumption during periods of inactivity. Up to 10 daily time bands can be associated with different operating set points. As an option (VPF

package), the modulation of capacity is integrated with the modulation of the water flow, by means of inverter and dedicated resources for the hydraulic circuit.



2.15 Versions

/K - Key efficiency

Key efficiency units that grant the best cooling capacity/footprint ratio.

/SL-K - Super low noise, standard efficiency

Key efficiency units that grant the best cooling capacity/footprint ratio.

This version features a special soundproofing for the compressor compartment and the pumps (if present), a reduced fan speed and an oversized condensing section.

The fan speed is automatically increased in case of particularly tough environmental conditions.

2.16 Configurations

- , standard unit

Standard unit for production of chilled water

/D, unit with partial heat recovery

Unit for the production of chilled water, equipped with an auxiliary heat exchanger (desuperheater) on the compressor discharge for superheat recovery. The recovered heat is approximately the 20% of the total cooling capacity and can be used for domestic hot water production or other secondary uses, such as the integration of an existing boiler.

/R, unit with total heat recovery

Unit for the production of chilled water, with a dedicated heat exchanger refrigerant/water for the condensation heat reclaim. The heat reclaim is managed to reach the set-point. This function is used for air treatment in applications with AHU or for domestic hot water production together with an auxiliary boiler.

3.1 ACCESSORIES

ACCESSORIES	DESCRIPTIONS	BENEFITS	AVAILABLE FOR MODELS
1560 POWER SUPPLY CONFIGURATION			
1561 DOUBLE POWER SUPPLY (ATS)	An ATS (Automatic Transfer Switch) is installed within the electrical board. The device automatically switches the electrical load between a principal power supply (i.e. mains) and an auxiliary power supply (i.e. backup generator). The ATS automatically senses if one of the sources has lost or gained power. When an outage occurs in the principal power supply, the switch autonomously switches over to the secondary line. When the main line becomes available again the supply is restored to this line. It is possible to set the line priority and frequency of checking.	It enhances system's redundancy and reliability. Reduces unit's downtime in case of mains power outage.	ALL
1562 DOUBLE P.SUPPLY (MOTOR. CH.OVER)	A motorized changeover is installed within the electrical board. The device switches the electrical load between a principal power supply (i.e. mains) and an auxiliary power supply (i.e. backup generator). The changeover is with remote control (i.e. signal of generator start up).	It enhances system's redundancy and reliability. Reduces unit's downtime in case of mains power outage.	ALL
1020 REGULATIONS			
1015 HEAT EXCHANGERS NSW CERTIFIED	Heat exchangers with SafeWork NSW certificate		ALL
1017 UNIT PED-UDT COMPLIANT	Unit PED-UDT compliant for Polish market		ALL
1019 HEAT EXCHANGERS AS1210 CERTIFIED	Heat exchangers AS1210 compliant (Australia Standard)		ALL
380 NUMBERED WIRING			
381 NUMBERED WIRING ON EL. BOARD	Electrical board wires are identified by numbered labels. The reference numbers are indicated in the unit's wiring scheme.	Facilitate maintenance interventions to the electrical board connections.	ALL
382 PWR WIRINGS ACC.TO UK REQUEST		Facilitate maintenance interventions to the electrical board connections.	ALL
383 NUMBERED WIRINGS+UK REQUESTS	Electrical board wires are identified by numbered labels. The reference numbers are indicated in the unit's wiring scheme.	Facilitate maintenance interventions to the electrical board connections.	ALL
3300 COMPRESSOR REPHASING			
3301 COMPR.POWER FACTOR CORR.	Capacitors on the compressors' power inlet line.	The unit's average cos(phi) increases.	ALL
1510 SOFT-STARTER			
1511 UNIT WITH SOFT-START	Electronic device adopted to manage the inrush current.	Break down of the inrush current compared to the direct motor start, lower motor windings' mechanical wear, avoidance of mains voltage fluctuations during starting, favourable sizing for the electrical system.	ALL
1513 UNIT WITH 3-PHASE SOFT-START	Electronic device adopted to manage the inrush current. The device controls the 3 phases.	Break down of the inrush current compared to the direct motor start, lower motor windings' mechanical wear, avoidance of mains voltage fluctuations during starting, favourable sizing for the electrical system.	ALL

ACCESSORIES

ACCESSORIES	DESCRIPTIONS	BENEFITS	AVAILABLE FOR MODELS
3410 AUTOMATIC CIRCUIT BREAKERS			
3411 AUTOM.CIRC.BREAKERS FOR COMPR.	Over-current switch on the compressors	In case of overcurrent allows resetting of the switch without the replacement of relative fuses.	ALL
3412 AUTOM. CIRCUIT BREAK. ON LOADS	Over-current switch on the major electrical loads.	In case of overcurrent allows resetting of the switch without the replacement of relative fuses.	ALL
3600 ON/OFF COMPRESSOR SIGNAL			
3601 COMPRESSOR OPERATION SIGNAL	Auxiliary contacts providing a voltage-free signal.	Allows remote signalling of compressor's activation or remote control of any auxiliary loads.	ALL
4180 REMOTE CONNECTION ARRANGEMENT			
4181 SERIAL CARD MODBUS	Interface module for ModBUS protocols.	Allows integration with BMS operating with ModBUS protocol.	ALL
4182 SERIAL CARD FOR LONWORKS	Interface module for Echelon systems.	Allows integration with BMS operating with LonWorks protocols	ALL
4184 SERIAL CARD BACNET MS/TP RS485	Interface module for BACnet protocols.	Allows integration with BMS operating with BACnet protocol.	ALL
4185 SERIAL CARD FOR BACNET OVER IP	Interface module for BACnet OVER-IP protocols.	Allows to interconnect BACnet devices over Internet Protocol within wide-area networks.	ALL
4187 M-Net W3000 INTERFACE KIT	Interface kit for M-Net protocol.	Interface module to allow the integration of the unit with Mitsubishi Electric proprietary communication protocol M-Net.	ALL
6160 AUXILIARY INPUT			
6161 AUXILIARY SIGNAL 4-20mA	4-20 mA analog input	Allows to change the operating set-point according to the value of current applied to the analogue input.	ALL
6162 REMOTE SIGNAL DOUBLE SP	Allows to activate the Energy Saving set-point.	Allows to change the operating set-point according to a remote switch	ALL
6170 DEMAND LIMIT			
6171 INPUT REMOTE DEMAND LIMIT	Digital input (voltage free)	It permits to limit the unit's power absorption for safety reasons or in temporary situation.	ALL
6180 REMOTE RECOVERY COMMAND			
6181 ON/OFF REMOTE RECOVERY SIGNAL	Digital input (voltage free)	Relay to remotely control the operation of the total heat recovery option.	ALL
1440 USER INTERFACE			
1442 KIPLink +7 INCH TOUCH SCREEN	In addition to KIPLink, the innovative user interface based on WiFi technology, the unit is equipped with the Touch interface, with a 7" WVGA colour display and a front USB port (WARNING: with outdoor temperature below 0°C the display response time may visibly increase).		ALL
1444 KIPLink + LARGE KEYBOARD	In addition to KIPLink, the innovative user interface based on WiFi technology, the unit is equipped with the Large keyboard with a wide LCD display and led icons.		ALL
6194 LARGE KEYBOARD	The unit is equipped with the Large keyboard with a wide LCD display and led icons.		ALL

ACCESSORIES

ACCESSORIES	DESCRIPTIONS	BENEFITS	AVAILABLE FOR MODELS
6195 7 INCH TOUCH SCREEN	The unit is equipped with the Touch interface, with a 7" WVGA colour display and a front USB port (WARNING: with outdoor temperature below 0°C the display response time may visibly increase).	The touch-screen's technology is characterized by an easy-to-access data, and it allows an effective graphical representation of the main figures protecting the access through 3 privilege levels.	ALL
6196 KIPLink	The unit is equipped with KIPLink, the innovative user interface based on WiFi technology		ALL
3420 LIGHTS ON ELECTRIC BOARD			
3421 LIGHTS ON ELECTRIC BOARD	Electrical board equipped with lights.	Facilitate electrical board maintainance interventions.	ALL
3390 ANTICONDENSATE HEATER EL.BOARD			
3391 ELECTRIC HEATER ON EL. BOARD	Electrical heater fed directly from the unit, is automatically activated at temperatures internal QE below 30 ° C (off state at T higher than 40 ° C).	It avoids the risk of humidity condensation on the electrical panel.	ALL
5920 MANAGEMENT & CONTROL SYSTEMS			
5921 NETWORK ANALYZER FOR DEMETRA	This option includes all following devices on-board the unit panel: - network analyzer operating on ModBUS protocol over RS-485 (without certification MID) - current transformers.	This accessory allows to acquire the electrical data and the power absorbed by the unit and send them via RS-485 bus to an external device for energy metering (DEMETRA - see dedicated manual).	ALL
5922 ClimaPRO ModBUS RS485 - MID	This option includes all following devices on-board the unit panel: - MID certified network analyzer operating on ModBUS over RS-485 - Current transformers - W3000TE controller - Software release LA09 or later version.	This accessory allows to acquire the electrical data and the power absorbed by the unit and communicate with ClimaPRO via high level communication interface based on ModBUS over EIA RS-485. More specifically, the data collected are: power supply, current, frequency, power factor (cos ϕ), electrical power consumption, energy consumption. This specific energy meter model is MID certified and can therefore be used for billing applications. This option also ensures the compatibility between the units and ClimaPRO, thus allowing ClimaPRO to acquire all the main unit's operating variables and status by means of a high level communication interface to the controller installed onboard the unit panel.	ALL
5923 ClimaPRO BacNET over IP	This option includes all following devices on-board the unit panel: - network analyzer operating on BACnet over IP - Current transformers - W3000TE controller - Software release LA09 or later version.	This accessory allows to acquire the electrical data and the power absorbed by the unit and communicate with ClimaPRO via high level communication interface based on BACnet over IP. More specifically, the data collected are: power supply, current, frequency, power factor (cos ϕ), electrical power consumption, energy consumption. This network analyzer is not MID certified and cannot therefore be used for billing applications. This option also ensures the compatibility between the units and ClimaPRO, thus allowing ClimaPRO to acquire all the main unit's operating variables and status by means of a high level communication interface to the controller installed onboard the unit panel.	ALL

ACCESSORIES

ACCESSORIES	DESCRIPTIONS	BENEFITS	AVAILABLE FOR MODELS
5924 ENERGY METER FOR BMS	This option includes all following devices on-board the unit panel: - network analyzer with display operating on ModBUS protocol over RS-485 (without certification MID) - current transformers.	This accessory allows to acquire the electrical data and the power absorbed by the unit and send them via RS-485 bus to the BMS for energy metering.	ALL
4500 FAST RESTART (UPS EXCLUDED)			
4501 FAST RESTART (UPS EXCLUDED)	Unit fast restart management after power failure	The management of the fast restart allows to minimize downtimes in case of power failure, keeping all the necessary unit safeties. This option requires an external 203V AC 300VA UPS power supply, by customer.	ALL
4502 FAST RESTART (UPS INCLUDED)	Unit fast restart management after power failure	The management of the fast restart allows to minimize downtimes in case of power failure, keeping all the necessary unit safeties. This option includes an electric device capable of keeping the controller power supply uninterrupted during a power failure. For duration of the UPS longer than 30 minutes, please contact our sales department.	ALL
1570 POWER SOCKET			
1571 POWER SOCKET 230V MAX 500VA	230V power socket in the electrical board, CEE 7/3 type (Schuko). The maximum power available is 500VA.	It allows to supply power to small electric/electronic devices (lights, notebook, tablet, etc.) during maintenance operation.	ALL
3430 REFRIGERANT LEAK DETECTOR			
3431 REFRIG. LEAK DETECTOR	Refrigerant leak detection system, supplied factory mounted and wired in the electrical board. In case of leak detection it will raise an alarm.	It promptly detects gas leakages	ALL
3433 GAS LEAK CONTACT + COMPR. OFF	Refrigerant leak detection system, supplied factory mounted and wired in the electrical board. In case of leak detection it will raise an alarm and stop the unit.	It promptly detects gas leakages and stops the unit	ALL
820 FAN CONTROL			
808 EC FANS	Electronically commutated fans (EC fans). The brushless motor, governed by a special controller, continuously adjust fans' speed.	Reduced energy consumption and minimized current's absorption during start-up phase. The efficiency is increased by approximately: +1% of EER and +4/5% of ESEER. The noise reduces proportionally to the unit's partialization.	ALL
1950 HIGH TEMPERATURE DEVICE			
1955 KIT HT	Kit to increase the unit's operating range.	Full load operation is guaranteed up to over 50°C of outdoor temperature (the limit depends on the unit version, further details are available in the operating limit section). In case of outdoor air temperature higher than 53°C, some additional cooling equipment for the electrical panel could be necessary (please refer to our sales department for assessment and quotation).	ALL
1960 PRESSURE RELIEF VALVES			
1961 DUAL RELIEF VALVES WITH SWITCH	Dual relief valve with switch	Allows to unselect a relief valve in order to service the unit avoiding medium or long inoperative periods	ALL

ACCESSORIES

ACCESSORIES	DESCRIPTIONS	BENEFITS	AVAILABLE FOR MODELS
1400 HP AND LP GAUGES			
1401 HP AND LP GAUGES	High and low pressure gauges	Allows immediate reading of the pressure values on both low and high pressure circuits	ALL
1900 COMPRESSOR SUCTION VALVE			
1901 COMPRESSOR SUCTION VALVE	Shut-off valve on compressor's suction circuit.	Simplifies maintenance activities	ALL
870 OPERATION RANGE UNIT			
871 NEGATIVE FLUID TEMPERATURE	Compressor's liquid injection	It permits the compressor works properly with high compression efficiency with negative evaporator leaving temperature	ALL
2880 EVAPORATOR WATER DELTA 10°C			
2881 EVAPORATOR FOR DELTA T>8°C	Evaporator dedicated to work with low primary circuit waterflow.	The heat exchange takes place under efficient conditions and the favorable sizing of primary pumps allows a considerable pumping energy saving.	ALL
2630 INSULATION ON EXCHANGERS			
2631 DOUBLE INSULATION ON EXCHANGERS	Thermal insulation in closed-cell flexible elastomeric foam (FEF) of 16 mm coupled with a 3 mm layer of reticulated foam in PE and an exterior embossed finishing PE film. This option is mandatory if the unit is supposed to work with outdoor temperature below -10°C.	Reduces heat losses and prevent from condensate problems.	ALL
2633 DOUBLE INSULATION ON EXCH+PIPES+PUMPS	Thermal insulation on heat exchangers in closed-cell flexible elastomeric foam (FEF) of 16 mm coupled with a 3 mm layer of reticulated foam in PE and an exterior embossed finishing PE film. Thermal insulation on pumps and pipes in closed-cell reticulated foam in PE of 20 mm. This option is mandatory if the unit is supposed to work with outdoor temperature below -10°C.	Reduces heat losses and prevent from condensate problems.	ALL
1800 EVAPORATOR WATER FLOW SWITCH			
1801 EVAPORATOR WATER FLOW SWITCH	Flow switch with stainless scoop AISI 316L and IP65 protection suitable for installation in industrial plant pipes. It should be installed in a straight pipe without filters, valves, etc., long at least 5 times its diameter, both upstream and downstream.	Signaling of lack of or excessive reduction of flow, it generates an alarm that is in automatic or manual reset depending on n ° alarms per hour and the maximum time of operation of the pump under conditions of low flow rate.	ALL
990 CONDENSING COIL			
876 E-COATING MICROCHANNEL COILS	The heat exchanger is completely treated by electrolysis so as to create a protective layer of epoxy polymer on the surface, with the following characteristics: - over 3120 hours of salt spray protection as per ASTM G85-02 A3 (SWAAT); - polyurethane surface protection against UV rays.	Provide a very high resistance against corrosion, also in very aggressive environment. For further information please refer to the Guidelines "Finned coil heat exchangers and protection against corrosion", available in the download section of the website www.climaveneta.com , or contact our sales department.	ALL
879 COPPER/ALUMINIUM COILS	Finned coil heat exchanger made from suitably-spaced copper tubes and aluminum fins designed to ensure maximum heat exchange efficiency.	Provide a good resistance against corrosion. For further information please refer to the Guidelines "Finned coil heat exchangers and protection against corrosion", available in the download section of the website www.climaveneta.com , or contact our sales department.	ALL

ACCESSORIES

ACCESSORIES	DESCRIPTIONS	BENEFITS	AVAILABLE FOR MODELS
881 Cu/Cu EXTERNAL COIL	Finned coil heat exchanger made from suitably-spaced copper tubes and fins designed to ensure maximum heat exchange efficiency.	This type of coil is not subject to galvanic corrosion, being made from just one material. For further information please refer to the Guidelines "Finned coil heat exchangers and protection against corrosion", available in the download section of the website www.climaveneta.com , or contact our sales department.	ALL
894 Cu PIPES/PREPARED ALL. FINIS	Finned coil heat exchanger made from copper tubes and aluminum fins with chemical cleaning treatment to remove impurities, and then coated with protective paint with the following characteristics: - fins treated with protective polyester resin paint; - over 1000 hours of salt spray protection as per ASTM B117 (fins without cross and protected edges); - excellent resistance to UV rays.	Provide a good resistance against corrosion. For further information please refer to the Guidelines "Finned coil heat exchangers and protection against corrosion", available in the download section of the website www.climaveneta.com , or contact our sales department.	ALL
895 FIN GUARD SILVER TREATM	Copper-aluminum heat exchanger coils with polyurethane paint Fin Guard Silver SB. Coil completely coated by a protective layer of polyurethane paint with the following characteristics: - polyurethane paint with metallic emulsion; - over 3000 hours of salt spray protection as per ASTM B117; - excellent resistance to UV rays; - high-pressure spray painting system.	Provide a very high resistance against corrosion, also in very aggressive environment. For further information please refer to the Guidelines "Finned coil heat exchangers and protection against corrosion", available in the download section of the website www.climaveneta.com , or contact our sales department.	ALL
840 DEVICE FOR LOW AIR TEMPERATURE			
813 LOW TEMP. DEVICE DBA	The device allows the partial flood of the condensing coils to reduce the heat exchange surface. It includes the liquid receivers and the valves and devices to manage the flooding.	Unit's operation is guaranteed for extremely low outdoor temperature (the limit depends on the unit version, further details are available in the operating limit section).	ALL
4700 EV - HYDRONIC MODULE			
4701 EV - NO PUMPS, NO CONTACTS	Evaporator hydronic module, compatible with constant flow control. The unit is provided without any water flow regulation device.	Constant water flow is to be provided by others.	ALL
4702 EV - RELAY 1 PUMP (ON/OFF)	Evaporator hydronic module, compatible with constant flow control. The unit is provided with 1 relay to control the activation of 1 external pump via single ON/OFF signal.	The hydronic module allows to control the external pumps with the unit controller logic.	ALL
4703 EV - RELAY 2 PUMPS (ON/OFF)	Evaporator hydronic module, compatible with constant flow control. The unit is provided with 2 relays to control the activation of 2 external pumps via double ON/OFF signal. The pumps are controlled in duty/standby, with running hours equalization and changeover on device failure.	The hydronic module allows to control the external pumps with the unit controller logic.	ALL
4706 EV - 1 PUMP 2P LH (FIX SPEED)	Evaporator hydronic module, compatible with constant flow control. The unit is provided with 1 fixed speed pump, with 2-pole motor. Residual head of 100 kPa approximately. Specifications and characteristic curves are available in the dedicated bulletin section.	The hydronic module includes the pumps and the main water circuit components, thus optimizing hydraulic and electrical installation space, time and costs.	ALL

ACCESSORIES

ACCESSORIES	DESCRIPTIONS	BENEFITS	AVAILABLE FOR MODELS
4707 EV - 1 PUMP 2P HH (FIX SPEED)	Evaporator hydronic module, compatible with constant flow control. The unit is provided with 1 fixed speed pump, with 2-pole motor. Residual head of 200 kPa approximately. Specifications and characteristic curves are available in the dedicated bulletin section.	The hydronic module includes the pumps and the main water circuit components, thus optimizing hydraulic and electrical installation space, time and costs.	ALL
4711 EV - 2 PUMPS 2P LH (FIX SPEED)	Evaporator hydronic module, compatible with constant flow control. The unit is provided with 2 fixed speed pumps, with 2-pole motor. Residual head of 100 kPa approximately. The pumps are controlled in duty/standby, with running hours equalization and changeover on device failure. Specifications and characteristic curves are available in the dedicated bulletin section.	The hydronic module includes the pumps and the main water circuit components, thus optimizing hydraulic and electrical installation space, time and costs.	ALL
4712 EV - 2 PUMPS 2P HH (FIX SPEED)	Evaporator hydronic module, compatible with constant flow control. The unit is provided with 2 fixed speed pumps, with 2-pole motor. Residual head of 200 kPa approximately. The pumps are controlled in duty/standby, with running hours equalization and changeover on device failure. Specifications and characteristic curves are available in the dedicated bulletin section.	The hydronic module includes the pumps and the main water circuit components, thus optimizing hydraulic and electrical installation space, time and costs.	ALL
4713 EV - RELAY 1 PUMP + 0-10V SIG	Evaporator hydronic module, compatible with constant or variable flow control. The unit is provided with 1 relay and a 0-10V signal terminal to control the activation and the speed of 1 external variable speed pump.	The hydronic module allows to control the external pumps with the unit controller logic.	ALL
4714 EV - RELAY 2 PUMPS + 0-10V SIG	Evaporator hydronic module, compatible with constant or variable flow control. The unit is provided with 2 relays and a 0-10V signal terminal to control the activation and the speed of 2 external variable speed pump. The pumps are controlled in duty/standby, with running hours equalization and changeover on device failure.	The hydronic module allows to control the external pumps with the unit controller logic.	ALL
4717 EV - 1 PUMP 2P LH (VAR SPEED)	Evaporator hydronic module, compatible with constant or variable flow control. The unit is provided with 1 variable speed pump, with 2-pole motor. Residual head of 100 kPa approximately. Specifications and characteristic curves are available in the dedicated bulletin section.	The hydronic module includes the pumps and the main water circuit components, thus optimizing hydraulic and electrical installation space, time and costs.	ALL
4718 EV - 1 PUMP 2P HH (VAR SPEED)	Evaporator hydronic module, compatible with constant or variable flow control. The unit is provided with 1 variable speed pump, with 2-pole motor. Residual head of 200 kPa approximately. Specifications and characteristic curves are available in the dedicated bulletin section.	The hydronic module includes the pumps and the main water circuit components, thus optimizing hydraulic and electrical installation space, time and costs.	ALL
4722 EV - 2 PUMPS 2P LH (VAR SPEED)	Evaporator hydronic module, compatible with constant or variable flow control. The unit is provided with 2 variable speed pumps, with 2-pole motor. Residual head of 100 kPa approximately. The pumps are controlled in duty/standby, with running hours equalization and changeover on device failure. Specifications and characteristic curves are available in the dedicated bulletin section.	The hydronic module includes the pumps and the main water circuit components, thus optimizing hydraulic and electrical installation space, time and costs.	ALL

ACCESSORIES

ACCESSORIES	DESCRIPTIONS	BENEFITS	AVAILABLE FOR MODELS
4723 EV - 2 PUMPS 2P HH (VAR SPEED)	Evaporator hydronic module, compatible with constant or variable flow control. The unit is provided with 2 variable speed pumps, with 2-pole motor. Residual head of 200 kPa approximately. The pumps are controlled in duty/standby, with running hours equalization and changeover on device failure. Specifications and characteristic curves are available in the dedicated bulletin section.	The hydronic module includes the pumps and the main water circuit components, thus optimizing hydraulic and electrical installation space, time and costs.	ALL
4860 EV - PRIMARY FLOW CONTROL			
4861 EV - CONSTANT FLOW	Evaporator water flow control (plant primary circuit): constant flow. Compatible with hydronic modules without regulation devices (no pumps, no contacts), with ON/OFF regulation devices (relays) or with fixed speed pumps (codes: 4701, 4702, 4703, 4704, 4705, 4706, 4707, 4708, 4709, 4711, 4712 - hydronic modules availability depends on unit model).	The unit is set up to operate with a constant water flow in the heat exchanger (plant primary circuit). This is the only option available in case of unit without any water flow regulation devices (no pumps, no contacts), which means with water flow control provided by others. In case of unit with ON/FF regulation devices or fixed speed pumps, the unit controller manages the pump activation to reduce pump consumption.	ALL
4862 EV - CONSTANT FLOW (PARAMETER)	Evaporator water flow control (plant primary circuit): constant flow (parameter set). Compatible with hydronic modules with modulating regulation devices (0-10V signal) or with variable speed pumps (codes: 4713, 4714, 4715, 4716, 4717, 4718, 4719, 4721, 4722, 4723 - hydronic modules availability depends on unit model).	The unit is set up to operate with a constant water flow in the heat exchanger (plant primary circuit). The unit controller manages the pump activation to reduce pump consumption. The pump speed is adjusted via 0-10V signal. The option provides the possibility to set the pump speed with a controller parameter. Once set, the speed pump remains constant until the next parameter adjustment. The parameter set constant flow control is useful during the unit installation and commissioning, to adjust water flow and pressure head according to the real plant characteristics.	ALL
4864 EV - VPF (plant DP trans excl)	Evaporator water flow control (plant primary circuit): variable flow (delta P control). Only for single unit systems. Compatible with hydronic modules with modulating regulation devices (0-10V signal) or with variable speed pumps (codes: 4713, 4714, 4715, 4716, 4717, 4718, 4719, 4721, 4722, 4723 - hydronic modules availability depends on unit model). The option includes: differential pressure transducer on the unit's heat exchanger and related controller expansion board, controller expansion board to read the plant side differential pressure transducer (4-20mA signal) and manage the hydraulic by-pass valve opening (0-10V signal). Compulsory equipment, supplied by others: plant side differential pressure transducer, plant side hydraulic by-pass valve.	The unit is set up to operate with a variable water flow in the heat exchanger (plant primary circuit). The unit controller manages the pump activation to reduce pump consumption. The pump speed is adjusted via 0-10V signal. The option provides a pump speed management based on the VPF (Variable Primary Flow) function. It keeps the delta P constant on the plant side (primary circuit), thus bringing significant pump consumption reduction during part load operation. The VPF function is applicable in systems with only the primary circuit. Further information available in the dedicated bulletin section.	ALL

ACCESSORIES

ACCESSORIES	DESCRIPTIONS	BENEFITS	AVAILABLE FOR MODELS
4865 EV - VPF (plant DP trans incl)	<p>Evaporator water flow control (plant primary circuit): variable flow (delta P control). Only for single unit systems.</p> <p>Compatible with hydronic modules with modulating regulation devices (0-10V signal) or with variable speed pumps (codes: 4713, 4714, 4715, 4716, 4717, 4718, 4719, 4721, 4722, 4723 - hydronic modules availability depends on unit model).</p> <p>The option includes: differential pressure transducer on the unit's heat exchanger and related controller expansion board, plant side differential pressure transducer (installation by others), controller expansion board to read the plant side differential pressure transducer (4-20mA signal) and manage the hydraulic by-pass valve opening (0-10V signal).</p> <p>Compulsory equipment, supplied by others: plant side hydraulic by-pass valve.</p>	<p>The unit is set up to operate with a variable water flow in the heat exchanger (plant primary circuit).</p> <p>The unit controller manages the pump activation to reduce pump consumption. The pump speed is adjusted via 0-10V signal.</p> <p>The option provides a pump speed management based on the VPF (Variable Primary Flow) function. It keeps the delta P constant on the plant side (primary circuit), thus bringing significant pump consumption reduction during part load operation.</p> <p>The VPF function is applicable in systems with only the primary circuit.</p> <p>Further information available in the dedicated bulletin section.</p>	ALL
4866 EV - VPF MULTI-UNIT SYSTEM	<p>Evaporator water flow control (plant primary circuit): variable flow (delta P control). Only for multi-unit systems.</p> <p>Compatible with hydronic modules with modulating regulation devices (0-10V signal) or with variable speed pumps (codes: 4713, 4714, 4715, 4716, 4717, 4718, 4719, 4721, 4722, 4723 - hydronic modules availability depends on unit model).</p> <p>The option includes: differential pressure transducer on the unit's heat exchanger and related controller expansion board.</p> <p>It shall be the customer responsibility to configure the multi-unit control system (Manager3000 or ClimaPRO) with option VPF.</p>	<p>The unit is set up to operate with a variable water flow in the heat exchanger (plant primary circuit).</p> <p>The unit controller manages the pump activation to reduce pump consumption. The pump speed is adjusted via 0-10V signal.</p> <p>The option provides a pump speed management based on the VPF (Variable Primary Flow) function. It keeps the delta P constant on the plant side (primary circuit), thus bringing significant pump consumption reduction during part load operation.</p> <p>The VPF function is applicable in systems with only the primary circuit.</p> <p>Further information available in the dedicated bulletin section.</p>	ALL
4867 EV - VPF.D	<p>Evaporator water flow control (plant primary circuit): variable flow (delta T control). Only for single unit systems.</p> <p>Compatible with hydronic modules with modulating regulation devices (0-10V signal) or with variable speed pumps (codes: 4713, 4714, 4715, 4716, 4717, 4718, 4719, 4721, 4722, 4723 - hydronic modules availability depends on unit model).</p> <p>The option includes: 2 plant side NTC temperature sensors (installation by others).</p>	<p>The unit is set up to operate with a variable water flow in the heat exchanger (plant primary circuit).</p> <p>The unit controller manages the pump activation to reduce pump consumption. The pump speed is adjusted via 0-10V signal.</p> <p>The option provides a pump speed management based on the VPF.D (Variable Primary Flow with Decoupler) function. It keeps the delta T constant on the plant side (primary circuit), thus bringing significant pump consumption reduction during part load operation.</p> <p>The VPF.D function is applicable in systems with the primary and secondary circuits separated by a hydraulic decoupler.</p> <p>Further information available in the dedicated bulletin section.</p>	ALL

ACCESSORIES

ACCESSORIES	DESCRIPTIONS	BENEFITS	AVAILABLE FOR MODELS
4868 EV - VPF.D MULTI-UNIT SYSTEM	Evaporator water flow control (plant primary circuit): variable flow (delta T control). Only for multi-unit systems. Compatible with hydronic modules with modulating regulation devices (0-10V signal) or with variable speed pumps (codes: 4713, 4714, 4715, 4716, 4717, 4718, 4719, 4721, 4722, 4723 - hydronic modules availability depends on unit model). It shall be the customer responsibility to configure the multi-unit control system (Manager3000 or ClimaPRO) with option VPF.D.	The unit is set up to operate with a variable water flow in the heat exchanger (plant primary circuit). The unit controller manages the pump activation to reduce pump consumption. The pump speed is adjusted via 0-10V signal. The option provides a pump speed management based on the VPF.D (Variable Primary Flow with Decoupler) function. It keeps the delta T constant on the plant side (primary circuit), thus bringing significant pump consumption reduction during part load operation. The VPF.D function is applicable in systems with the primary and secondary circuits separated by a hydraulic decoupler. Further information available in the dedicated bulletin section.	ALL
2910 HYDRAULIC CONNECTIONS			
2911 FLANGED HYDRAULIC CONNECTIONS	Grooved coupling with flanged counter-pipe user/source side.		ALL
3370 D - HYDRONIC MODULE			
3371 D - RELAY 1 PUMP (ON/OFF)	Desuperheater hydronic module. The unit is provided with 1 relay to control the activation of 1 external pump via single ON/OFF signal.	The hydronic module allows to control the external pumps with the unit controller logic. The partial heat recovery pumps are activated only when heat recovery is actually possible: compressors on, hot storage tank temperature lower than set-point and than compressor outlet gas temperature. The option minimizes pump consumption.	ALL
4800 R - HYDRONIC MODULE			
4801 R - NO PUMPS, NO CONTACTS	Total heat recovery exchanger hydronic module, compatible with constant flow control. The unit is provided without any water flow regulation device.	Constant water flow is to be provided by others.	ALL
4802 R - RELAY 1 PUMP (ON/OFF)	Total heat recovery exchanger hydronic module, compatible with constant flow control. The unit is provided with 1 relay to control the activation of 1 external pump via single ON/OFF signal.	The hydronic module allows to control the external pumps with the unit controller logic.	ALL
4803 R - RELAY 2 PUMPS (ON/OFF)	Total heat recovery exchanger hydronic module, compatible with constant flow control. The unit is provided with 2 relays to control the activation of 2 external pumps via double ON/OFF signal. The pumps are controlled in duty/standby, with running hours equalization and changeover on device failure.	The hydronic module allows to control the external pumps with the unit controller logic.	ALL

ACCESSORIES

ACCESSORIES	DESCRIPTIONS	BENEFITS	AVAILABLE FOR MODELS
4880 R - PRIMARY FLOW CONTROL			
4881 R - CONSTANT FLOW	Total heat recovery exchanger water flow control (plant primary circuit): constant flow. Compatible with hydronic modules without regulation devices (no pumps, no contacts), with ON/OFF regulation devices (relays) or with fixed speed pumps (codes: 4801, 4802, 4803, 4804, 4805, 4806, 4807, 4808, 4809, 4811, 4812 - hydronic modules availability depends on unit model).	The unit is set up to operate with a constant water flow in the heat exchanger (plant primary circuit). This is the only option available in case of unit without any water flow regulation devices (no pumps, no contacts), which means with water flow control provided by others. In case of unit with ON/FF regulation devices or fixed speed pumps, the unit controller manages the pump activation to reduce pump consumption.	ALL
2430 PIPING KIT ANTIFREEZE HEATER			
2432 ANTIFREEZE PIPING, PUMPS	Electrical heaters on pipes and other hydraulic unit's components. This option is mandatory if the unit is supposed to work with outdoor temperature below 0°C.	It protects the unit against ice formation on its hydraulic components.	ALL
2680 WATER CONNECTIONS ORIENTATION			
2685 EVAP. CONNECTION RIGHT HAND SIDE			ALL
2686 EVAP. CONNECTION LEFT HAND SIDE			ALL
2340 UNIT ENCLOSURE			
2301 COMPRESS.ACOUSTICAL ENCLOSURE	Enclosure made from hot galvanised metal plate and painted with epoxy powder coat. The acoustic insulation availability depends on unit model, see the dedicated description in "Accessories notes".	It reduces the noise emissions and improves aesthetics.	ALL
2315 NOISE REDUCER	The option includes the fan speed reduction and the compressors' acoustical enclosure	The dedicated fans' speed calibration together with the soundproofing of the most critical components permit a significant noise reduction (for the precise performance of the unit with the Noise Reducer kit please refer to the selection software ELCA Studio).	ALL
2020 ANTI-INTRUSION GRILLS			
2021 ANTI-INTRUSION GRILLS	Anti-intrusions grills	Avoid the intrusion of solid bodies into the unit's structure.	ALL
2100 ANTIVIBRATION MOUNTING			
2101 RUBBER TYPE ANTIVIBR.MOUNTING			ALL
2102 SPRING TYPE ANTIVIBR.MOUNTING			ALL
1970 LONG DISTANCE TRANSPORTATION			
1971 REINFORCING BARS	Bars used to reinforce the structure	Improve resistance during long transportation	ALL
9970 PACKING			
9966 NYLON PACKING	Unit covered with nylon		ALL
9979 CONTAINER PACKING	Unit provided with container slides and covered with nylon		ALL

ACCESSORIES

Additional information - IMPORTANT -

1561 - Double power supply (ATS)

In some units, the transfer switch requires an enlarged electrical board. This entails a unit length increase. For further information, please contact our sales department.

1562 - Double power supply (motorized changeover)

These accessories entail the substitution of the standard general lock door isolator with a door microswitch that switches the changeover to 0 position (open).

In some units, the transfer switch requires an enlarged electrical board. This entails a unit length increase. For further information, please contact our sales department.

1015 - Heat exchangers NSW certified

1019 - Heat exchangers AS1210 certified

The certification is available for the evaporator only. If the certification is required also for the recovery heat exchanger (version /D /R), please contact our sales department.

1511 - Unit with soft-start

The device has an effect on 2 phases.

1511 - Unit with soft-start

1513 - Unit with 3-phase soft-start

The accessory requires the use of automatic circuit breakers on the compressors.

Please select one of the following accessories:

3411 - Automatic circuit breakers for compressors

3412 - Automatic circuit breakers on loads.

3431 - Refrigerant leak detector

3433 - Refrigerant leak detector + compressors off

The accessory requires the compressor enclosure.

The compressor enclosure is present as per standard in all the silenced units (version: SL-K).

For the not-silenced units (version: K), please select one of the following accessories:

2301 - Compressor acoustical enclosure

2315 - Noise Reducer.

4501 - Fast restart (UPS excluded)

In some units, the transfer switch requires an enlarged electrical board. This entails a unit length increase. For further information, please contact our sales department.

4502 - Fast restart (UPS included)

The following tables show the first compressor start-up time and ramp-up time for 100% cooling capacity.

The time frames shown in Table 1 and 2 are defined by the power restoration.

Table 1 - First compressor start-up time

Standard unit ⁽¹⁾	Unit with fast restart ⁽¹⁾
5' 40"	25"

(1) Minimum time from its previous start-up and minimum off-time need to be fulfilled to start the compressor.

Table 2 - Ramp-up time for 100% cooling capacity

Compressor number	Standard unit ⁽²⁾⁽³⁾	Unit with fast restart ⁽²⁾⁽³⁾
1	8' 40"	2' 50"
2	11' 50"	3' 00"
3	15' 00"	3' 10"

(2) Reference conditions: plant (side) cooling exchanger water (in/out) 12°C / 7°C; Source (side) heat exchanger air (in) 35°C.

(3) Minimum time from their previous start-up and minimum off-time need to be fulfilled to start the compressors.

With the fast restart, each compressor can only start after 15' from its previous start-up and 1' 30" of off-time.

Without the fast restart, each compressor can only start after 15' from its previous start-up and 5' 00" of off-time.

The fast restart can be activated only 2 times every 24 hours.

It is possible to request the fast restart activation for 4 times every 24 hours (in this case the minimum off-time of each compressor will increase from 1' 30" to 2' 30"). For further information, please contact our sales department.

When the maximum number of fast restarts in a single 24 hour period is reached, the fast restart function is disabled and other potential restarts will follow the standard timing. Once the 24 hours have passed, the fast restart function is automatically enabled again.

In some units, the transfer switch requires an enlarged electrical board. This entails a unit length increase. For further information, please contact our sales department.

1955 - Kit HT

The accessory could entail a unit length increase. For further information, please contact our sales department.

808 - EC fans

These fans are suitable to operate up to 46°C of outdoor temperature.

In case of higher temperatures, fans with oversized motors must be used. For the quotation of these components, please contact our sales department.

1801 - Evaporator water flow switch

The accessory is supplied loose.

2301 - Compressor acoustical enclosure

Soundproofing insulation characteristics: 30 mm thick Fiberform (polyester fibres).

Sound power reduction: -2 dB(A).

2315 - Noise Reducer

Soundproofing insulation characteristics: 30 mm thick Fiberform (polyester fibres).

Fan speed reduction.

Sound power reduction: -7 dB(A).

4864 - EV - VPF (plant DP trans excl)

4865 - EV - VPF (plant DP trans incl)

4866 - EV - VPF multi-unit system

With these accessories, the minimum leaving water temperature admitted is 5°C.

ACCESSORIES

4867 - EV - VPF.D

4868 - EV - VPF.D multi-unit system

With these accessories, the minimum leaving water temperature admitted is 5°C.

4706 - EV - 1 PUMP 2P LH (FIX SPEED)

4707 - EV - 1 PUMP 2P HH (FIX SPEED)

4711 - EV - 2 PUMPS 2P LH (FIX SPEED)

4712 - EV - 2 PUMPS 2P HH (FIX SPEED)

4717 - EV - 1 PUMP 2P LH (VAR SPEED)

4718 - EV - 1 PUMP 2P HH (VAR SPEED)

4722 - EV - 2 PUMPS 2P LH (VAR SPEED)

4723 - EV - 2 PUMPS 2P HH (VAR SPEED)

For units with heat recovery (versions /D /R), the pump group may increase the unit's length by 1250 mm. For further information, please contact our sales department.

C926108911 - KIT remote touch screen 7"

The following electrical components are to be supplied by the customer:

- 24Vac or 24Vdc power supply for I_{max}=1A
- Serial cable 3x1 mm² shielded and twisted, max length 500m total.

The remote keyboard can control up to 8 units (of which up to 6 with the +2P module) with the same software version.

C926108913 - KIT remote touch screen 13"

The following electrical components are to be supplied by the customer:


- 24Vdc power supply for I_{max}=2A
- Serial cable 3x1 mm² shielded and twisted, max length 500m total.

The remote keyboard can control up to 8 units (of which up to 6 with the +2P module) with the same software version.

3371 - D - Relay 1 pump (ON/OFF)

The operating diagram of the device is provided below.

Figure 1 - Operating diagram of the "partial heat recovery control" device for a unit with two refrigerant circuits.

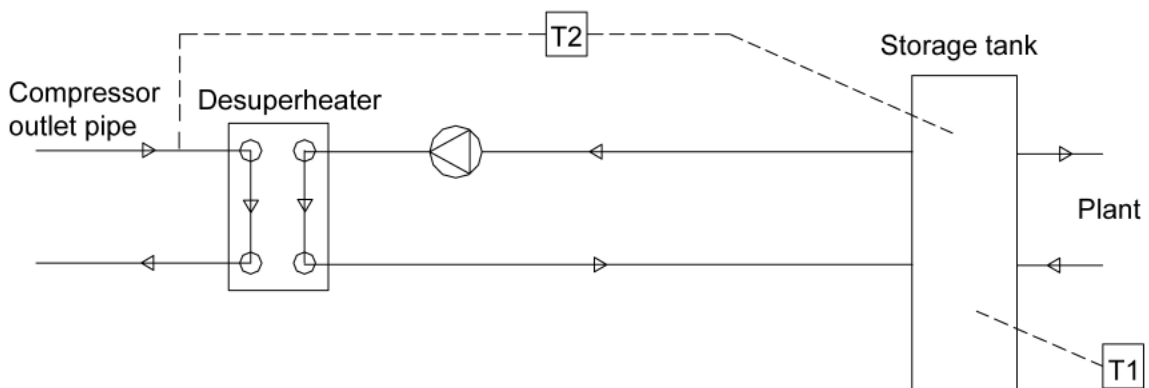

Note: the thermostats T1 and T2 are supplied cabled. It is the customer's responsibility to place the temperature probes in the storage.

ACCESSORIES

Chiller Plant Control with Active Optimization System

ClimaPRO System Manager

ClimaPRO System Manager represents the state-of-the-art platform for chiller plant management and control.

ClimaPRO ensures to actively optimize the entire chiller plant by managing and adjusting each component directly involved in the production and the distribution of the heating and the cooling energies, therefore involving chillers and heat pumps, pumping groups as well as the source-side devices like, for example, the cooling towers.

In particular, ClimaPRO measures in real-time all the operating variables from the field, for each individual device and each of the main system branches, by using serial communication lines as well as dedicated analogue signals.

The acquired data are then compared with the design data of each single unit at any different working conditions, thus allowing to implement control strategies based on dynamic algorithms which take into account the real operating conditions.

On the basis of these values, an advanced diagnostic module also allows to assess the level of efficiency for each individual unit, translating data into easy-to-read information in order to simplify and optimize the maintenance activities.

The "Chart Builder" software module allows to display the trends of the main operating variables. The "Reporting" module allows to send reports to selected users, including data and system's status of the main devices as well as to perform calculation of the energy indexes for each single unit and for the entire chiller plant.

The accessibility to ClimaPRO System Manager is ensured by an integrated web server that makes it visible from any computer equipped with a web browser, either locally or remotely.



4.1 GENERAL TECHNICAL DATA

FR-G05-Z /K

[SI System]

FR-G05-Z /K		0751	0851	0951	0961	1101	1301	1401	1421	1431	1801	
Power supply		V/ph/Hz 400/3/50 400/3/50 400/3/50 400/3/50 400/3/50 400/3/50 400/3/50 400/3/50 400/3/50 400/3/50										
PERFORMANCE												
COOLING ONLY (GROSS VALUE)												
Cooling capacity	(1)	kW	145,5	160,1	202,8	221,9	238,0	274,7	299,1	329,0	347,7	395,7
Total power input	(1)	kW	52,12	61,09	66,27	76,37	88,76	91,61	106,9	123,7	116,2	140,9
EER	(1)	kW/kW	2,793	2,620	3,059	2,904	2,680	2,999	2,798	2,660	2,992	2,808
ESEER	(1)	kW/kW	3,930	3,920	3,970	4,010	4,000	4,020	3,970	3,990	3,940	3,960
COOLING ONLY (EN14511 VALUE)												
Cooling capacity	(1)(2)	kW	145,1	159,7	202,1	221,1	237,1	273,7	297,8	327,7	346,8	394,4
EER	(1)(2)	kW/kW	2,760	2,600	3,020	2,860	2,640	2,950	2,750	2,620	2,960	2,770
ESEER	(1)(2)	kW/kW	3,830	3,840	3,850	3,880	3,870	3,890	3,820	3,850	3,860	3,850
Cooling energy class			C	D	B	C	D	B	C	D	B	C
COOLING WITH PARTIAL RECOVERY												
Cooling capacity	(3)	kW	150,9	166,1	210,4	230,2	247,0	285,0	310,3	341,4	360,8	410,5
Total power input	(3)	kW	50,43	59,09	64,15	73,90	85,85	88,67	103,4	119,6	112,4	136,3
Desuperheater heating capacity	(3)	kW	43,14	51,14	54,07	63,08	74,14	74,99	88,61	103,6	95,22	117,3
COOLING WITH TOTAL HEAT RECOVERY												
Cooling capacity	(4)	kW	150,1	170,8	204,3	224,5	253,1	279,4	311,5	343,1	349,4	426,4
Total power input	(4)	kW	44,23	50,72	58,27	65,09	73,63	79,56	90,50	100,3	100,7	118,9
Recovery heat exchanger capacity	(4)	kW	191,6	218,4	259,1	285,7	322,3	354,2	396,6	437,4	444,0	538,2
EXCHANGERS												
HEAT EXCHANGER USER SIDE IN REFRIGERATION												
Water flow	(1)	l/s	6,957	7,654	9,696	10,61	11,38	13,14	14,30	15,73	16,63	18,92
Pressure drop	(1)	kPa	20,6	20,1	30,2	36,2	41,6	42,5	50,4	44,9	29,5	38,2
PARTIAL RECOVERY USER SIDE IN REFRIGERATION												
Water flow	(3)	l/s	2,082	2,469	2,610	3,045	3,579	3,620	4,277	5,002	4,596	5,660
Pressure drop	(3)	kPa	33,0	46,4	51,9	35,1	48,5	49,6	34,1	46,7	39,4	34,9
HEAT EXCHANGER RECOVERY USER SIDE IN REFRIGERATION												
Water flow	(4)	l/s	9,250	10,54	12,50	13,79	15,56	17,10	19,14	21,11	21,43	25,98
Pressure drop	(4)	kPa	30,3	31,4	30,8	30,6	31,4	37,9	37,0	38,7	39,9	29,7
REFRIGERANT CIRCUIT												
Compressors nr.		N°	1	1	1	1	1	1	1	1	1	1
Number of capacity steps		N°	0	0	0	0	0	0	0	0	0	0
No. Circuits		N°	1	1	1	1	1	1	1	1	1	1
Regulation			STEPLESS	STEPLESS	STEPLESS	STEPLESS	STEPLESS	STEPLESS	STEPLESS	STEPLESS	STEPLESS	STEPLESS
Min. capacity step		%	40	40	40	40	40	40	40	40	40	40
Refrigerant			R513A	R513A	R513A	R513A	R513A	R513A	R513A	R513A	R513A	R513A
Refrigerant charge		kg	23,0	25,0	32,0	36,0	38,0	44,0	48,0	53,0	56,0	63,0
Oil charge		kg	15,0	15,0	15,0	15,0	22,0	19,0	19,0	19,0	19,0	30,0
Rc (ASHRAE)	(5)	kg/kW	0,16	0,16	0,16	0,16	0,16	0,16	0,16	0,16	0,16	0,16
FANS												
Quantity		N°	2	2	3	3	3	4	4	4	5	5
Air flow		m ³ /s	10,52	10,52	15,79	15,79	15,79	21,05	21,05	21,05	26,31	26,31
Fans power input		kW	1,90	1,90	1,90	1,90	1,90	1,90	1,90	1,90	1,90	1,90
NOISE LEVEL												
Sound Pressure	(6)	dB(A)	62	62	62	62	64	64	65	66	66	66
Sound power level in cooling	(7)(8)	dB(A)	94	94	94	94	96	96	97	98	98	98
SIZE AND WEIGHT												
A	(9)	mm	1500	1500	2750	2750	2750	2750	2750	2750	4000	4000
B	(9)	mm	2260	2260	2260	2260	2260	2260	2260	2260	2260	2260
H	(9)	mm	2500	2500	2500	2500	2500	2500	2500	2500	2500	2500
Operating weight	(9)	kg	1480	1510	2100	2130	2460	2510	2540	2580	3110	3540

Notes:

- 1 Plant (side) cooling exchanger water (in/out) 12,00°C/7,00°C; Source (side) heat exchanger air (in) 35,0°C.
- 2 Values in compliance with EN14511-3:2013.
- 3 Plant (side) cooling exchanger water (in/out) 12,00°C/7,00°C; Source (side) heat exchanger air (in) 35,0°C; Plant (side) heat exchanger recovery water (in/out) 40,00°C/45,00°C.
- 4 Plant (side) cooling exchanger water (in/out) 12,00°C/7,00°C; Plant (side) heat exchanger recovery water (in/out) 40,00°C/45,00°C.
- 5 Rated in accordance with AHRI Standard 550/590 (2011 with addendum 1).
- 6 Average sound pressure level at 10m distance, unit in a free field on a reflective surface; non-binding value calculated from the sound power level.
- 7 Sound power on the basis of measurements made in compliance with ISO 9614.
- 8 Sound power level in cooling, outdoors.
- 9 Unit in standard configuration/execution, without optional accessories.

- Not available

Certified data in EUROVENT

GENERAL TECHNICAL DATA

FR-G05-Z /SL-K

[SI System]

FR-G05-Z /SL-K		0751	0851	0951	0961	1101	1301	1401	1421	1431	1801	
Power supply		V/ph/Hz 400/3/50 400/3/50 400/3/50 400/3/50 400/3/50 400/3/50 400/3/50 400/3/50 400/3/50 400/3/50										
PERFORMANCE												
COOLING ONLY (GROSS VALUE)												
Cooling capacity	(1)	kW	140,1	169,5	195,5	214,7	245,9	265,0	287,8	331,8	346,5	395,0
Total power input	(1)	kW	52,54	56,12	66,96	78,02	83,46	92,83	109,0	117,3	112,3	135,5
EER	(1)	kW/kW	2,669	3,021	2,918	2,753	2,945	2,856	2,640	2,829	3,085	2,915
ESEER	(1)	kW/kW	3,940	4,130	3,940	4,050	4,060	4,050	3,940	4,180	4,290	4,010
COOLING ONLY (EN14511 VALUE)												
Cooling capacity	(1)(2)	kW	139,7	169,0	194,9	214,0	244,9	264,1	286,6	330,5	345,6	393,7
EER	(1)(2)	kW/kW	2,640	2,990	2,880	2,720	2,900	2,820	2,600	2,790	3,050	2,880
ESEER	(1)(2)	kW/kW	3,840	4,020	3,840	3,930	3,920	3,930	3,800	4,030	4,180	3,900
Cooling energy class			D	B	C	C	B	C	D	C	B	C
COOLING WITH PARTIAL RECOVERY												
Cooling capacity	(3)	kW	145,3	175,9	202,9	222,8	255,1	274,9	298,6	344,2	359,4	409,8
Total power input	(3)	kW	50,80	54,30	64,76	75,44	80,73	89,77	105,4	113,4	108,6	131,1
Desuperheater heating capacity	(3)	kW	44,40	46,34	56,02	65,89	69,50	77,86	92,29	98,44	92,72	113,5
COOLING WITH TOTAL HEAT RECOVERY												
Cooling capacity	(4)	kW	150,1	170,8	204,3	224,5	253,1	279,4	311,5	343,1	349,4	426,4
Total power input	(4)	kW	44,23	50,72	58,27	65,09	73,63	79,56	90,50	100,3	100,7	118,9
Recovery heat exchanger capacity	(4)	kW	191,6	218,4	259,1	285,7	322,3	354,2	396,6	437,4	444,0	538,2
EXCHANGERS												
HEAT EXCHANGER USER SIDE IN REFRIGERATION												
Water flow	(1)	l/s	6,698	8,107	9,351	10,27	11,76	12,67	13,76	15,86	16,57	18,89
Pressure drop	(1)	kPa	19,1	22,6	28,1	33,9	44,4	39,5	46,6	45,7	29,3	38,1
PARTIAL RECOVERY USER SIDE IN REFRIGERATION												
Water flow	(3)	l/s	2,143	2,237	2,704	3,181	3,355	3,758	4,455	4,752	4,476	5,477
Pressure drop	(3)	kPa	35,0	38,1	55,7	38,3	42,6	53,5	37,0	42,1	37,4	32,7
HEAT EXCHANGER RECOVERY USER SIDE IN REFRIGERATION												
Water flow	(4)	l/s	9,250	10,54	12,50	13,79	15,56	17,10	19,14	21,11	21,43	25,98
Pressure drop	(4)	kPa	30,3	31,4	30,8	30,6	31,4	37,9	37,0	38,7	39,9	29,7
REFRIGERANT CIRCUIT												
Compressors nr.		N°	1	1	1	1	1	1	1	1	1	1
Number of capacity steps		N°	0	0	0	0	0	0	0	0	0	0
No. Circuits		N°	1	1	1	1	1	1	1	1	1	1
Regulation			STEPLESS	STEPLESS	STEPLESS	STEPLESS	STEPLESS	STEPLESS	STEPLESS	STEPLESS	STEPLESS	STEPLESS
Min. capacity step		%	40	40	40	40	40	40	40	40	40	40
Refrigerant			R513A	R513A	R513A	R513A	R513A	R513A	R513A	R513A	R513A	R513A
Refrigerant charge		kg	24,0	29,0	33,0	37,0	43,0	46,0	49,0	58,0	60,0	68,0
Oil charge		kg	15,0	15,0	15,0	15,0	22,0	19,0	19,0	19,0	19,0	30,0
Rc (ASHRAE)	(5)	kg/kW	0,17	0,17	0,17	0,17	0,18	0,18	0,17	0,18	0,17	0,17
FANS												
Quantity		N°	2	3	3	3	4	4	4	5	6	6
Air flow		m³/s	9,50	14,25	14,25	14,25	19,00	19,00	19,00	23,75	28,50	28,50
Fans power input		kW	1,40	1,40	1,40	1,40	1,40	1,40	1,40	1,40	1,40	1,40
NOISE LEVEL												
Sound Pressure	(6)	dB(A)	52	52	53	53	55	55	56	57	57	57
Sound power level in cooling	(7)(8)	dB(A)	84	84	85	85	87	87	88	89	89	89
SIZE AND WEIGHT												
A	(9)	mm	1500	2750	2750	2750	2750	2750	2750	4000	4000	4000
B	(9)	mm	2260	2260	2260	2260	2260	2260	2260	2260	2260	2260
H	(9)	mm	2500	2500	2500	2500	2500	2500	2500	2500	2500	2500
Operating weight	(9)	kg	1640	2050	2270	2290	2770	2770	2790	3250	3410	3880

Notes:

- 1 Plant (side) cooling exchanger water (in/out) 12,00°C/7,00°C; Source (side) heat exchanger air (in) 35,0°C.
- 2 Values in compliance with EN14511-3:2013.
- 3 Plant (side) cooling exchanger water (in/out) 12,00°C/7,00°C; Source (side) heat exchanger air (in) 35,0°C; Plant (side) heat exchanger recovery water (in/out) 40,00°C/45,00°C.
- 4 Plant (side) cooling exchanger water (in/out) 12,00°C/7,00°C; Plant (side) heat exchanger recovery water (in/out) 40,00°C/45,00°C.
- 5 Rated in accordance with AHRI Standard 550/590 (2011 with addendum 1).
- 6 Average sound pressure level at 10m distance, unit in a free field on a reflective surface; non-binding value calculated from the sound power level.
- 7 Sound power on the basis of measurements made in compliance with ISO 9614.
- 8 Sound power level in cooling, outdoors.
- 9 Unit in standard configuration/execution, without optional accessories.

- Not available

Certified data in EUROVENT

GENERAL TECHNICAL DATA

ENERGY EFFICIENCY

SEASONAL EFFICIENCY IN COOLING (Reg. EU 2016/2281) Process refrigeration at high temperature

FR-G05-Z /K			0751	0851	0951	0961	1101	1301	1401	1421	1431	1801
Prated,c	(1)	kW	145,1	159,7	202,1	221,1	237,1	273,7	297,8	327,7	346,8	394,4
SEPR	(1) (2)	-	5,00	5,24	5,01	5,00	5,25	5,00	5,01	5,00	5,00	5,14
FR-G05-Z /SL-K			0751	0851	0951	0961	1101	1301	1401	1421	1431	1801
Prated,c	(1)	kW	139,7	169,0	194,9	214,0	244,9	264,1	286,6	330,5	345,6	393,7
SEPR	(1) (2)	-	5,06	5,68	5,04	5,01	5,40	5,00	5,04	5,19	5,38	5,22

Notes:


(1) Seasonal energy efficiency of high temperature process cooling [REGULATION (EU) N. 2016/2281]

(2) Seasonal process cooling energy index

Certified data in EUROVENT

5.1 OPERATING LIMITS

/K 0751 - 1801
/SL-K 0751 - 1801

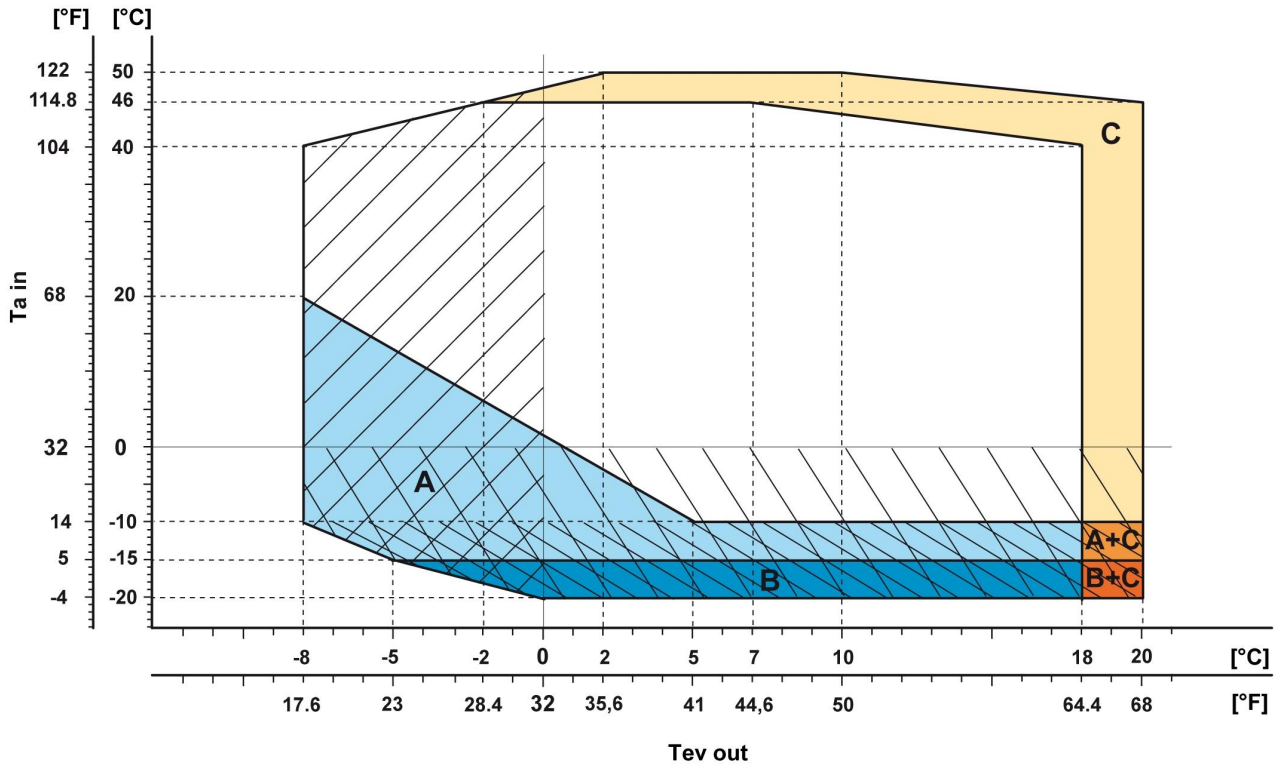

Ta in Air temperature
Tev out Evaporator leaving water temperature

- Standard units
- Required: EC fans (code 808)*
- Required: EC fans (code 808)*
Low temperature device DBA (code 813)
- Required: Kit HT (code 1955)
- Required: EC fans (code 808)*
Kit HT (code 1955)
- Required: EC fans (code 808)*
Low temperature device DBA (code 813)
Kit HT (code 1955)
- Required: Antifreeze piping and pumps (code 2432)
if hydronic kit is present
- Required: Double insultaion on heat exchangers (code 2631)
or Double insulation on heat exchangers, pipes and
pumps (code 2633) if hydronic kit is present
- Required: Negative fluid temperature (code 871)

The diagram shows the temperature limits of full load operation.
In case of higher outdoor air temperature, automatically
partialized its resources to ensure uninterrupted operation.
Operating limits when working partialized (water *7°C - */44,6°F):
/K, /SL-K: 53°C - 131°F
/kit HT (all versions): 57°C - 134,6°F

In case of outdoor air temperature higher than 53°C - 127,4°F,
some additional cooling equipment for the electrical panel could be
necessary. Please refer to our sales department for assessment
and quotation.

Units with heat recovery: /D, /R
For the units with heat recovery, the maximum outdoor temperature
allowed are 1,5°C - 2,7°F lower than the ones of the corresponding
model without heat recovery.

* EC fans are suitable to operate up to 46°C - 114,8°F of outdoor
temperature. In case of higher temperatures, fans with oversized
motors must be used. For the quotation of these components,
please contact our sales department.

For the specific temperature limits of each model please refer to the
selection software ElcaStudio.

OPERATING LIMITS

FR-G05-Z 0751 - 1801

SIZE	
FR-G05-Z /K /0751	FR-G05-Z /R /SL-K /1101
FR-G05-Z /K /0851	FR-G05-Z /R /SL-K /1301
FR-G05-Z /K /0951	FR-G05-Z /R /SL-K /1401
FR-G05-Z /K /0961	FR-G05-Z /R /SL-K /1421
FR-G05-Z /K /1101	FR-G05-Z /R /SL-K /1431
FR-G05-Z /K /1301	FR-G05-Z /R /SL-K /1801
FR-G05-Z /K /1401	
FR-G05-Z /K /1421	
FR-G05-Z /K /1431	
FR-G05-Z /K /1801	
FR-G05-Z /D /K /0751	
FR-G05-Z /D /K /0851	
FR-G05-Z /D /K /0951	
FR-G05-Z /D /K /0961	
FR-G05-Z /D /K /1101	
FR-G05-Z /D /K /1301	
FR-G05-Z /D /K /1401	
FR-G05-Z /D /K /1421	
FR-G05-Z /D /K /1431	
FR-G05-Z /D /K /1801	
FR-G05-Z /R /K /0751	
FR-G05-Z /R /K /0851	
FR-G05-Z /R /K /0951	
FR-G05-Z /R /K /0961	
FR-G05-Z /R /K /1101	
FR-G05-Z /R /K /1301	
FR-G05-Z /R /K /1401	
FR-G05-Z /R /K /1421	
FR-G05-Z /R /K /1431	
FR-G05-Z /R /K /1801	
FR-G05-Z /SL-K /0751	
FR-G05-Z /SL-K /0851	
FR-G05-Z /SL-K /0951	
FR-G05-Z /SL-K /0961	
FR-G05-Z /SL-K /1101	
FR-G05-Z /SL-K /1301	
FR-G05-Z /SL-K /1401	
FR-G05-Z /SL-K /1421	
FR-G05-Z /SL-K /1431	
FR-G05-Z /SL-K /1801	
FR-G05-Z /D /SL-K /0751	
FR-G05-Z /D /SL-K /0851	
FR-G05-Z /D /SL-K /0951	
FR-G05-Z /D /SL-K /0961	
FR-G05-Z /D /SL-K /1101	
FR-G05-Z /D /SL-K /1301	
FR-G05-Z /D /SL-K /1401	
FR-G05-Z /D /SL-K /1421	
FR-G05-Z /D /SL-K /1431	
FR-G05-Z /D /SL-K /1801	
FR-G05-Z /R /SL-K /0751	
FR-G05-Z /R /SL-K /0851	
FR-G05-Z /R /SL-K /0951	
FR-G05-Z /R /SL-K /0961	

5.2 ETHYLENE GLYCOL MIXTURE

Ethylene glycol and water mixture, used as a heat-conveying fluid, cause a variation in unit performance. For correct data, use the factors indicated in the following tabel.

	Freezing point (°C)							
	0	-5	-10	-15	-20	-25	-30	-35
	Ethylene glycol percentage by weight							
	0%	12%	20%	30%	35%	40%	45%	50%
cPf	1	0,985	0,98	0,974	0,97	0,965	0,964	0,96
cQ	1	1,02	1,04	1,075	1,11	1,14	1,17	1,2
cdp	1	1,07	1,11	1,18	1,22	1,24	1,27	1,3

cPf: cooling power correction factor
 cQ: flow correction factor
 cdp: pressure drop correction factor

For data concerning other kind of anti-freeze solutions (e.g. propylene glycol) please contact our Sale Department.

5.3 FOULING FACTORS

Performances are based on clean condition of tubes (fouling factor = 1). For different fouling values, performance should be adjusted using the correction factors shown in the following table.

SERIES	FOULING FACTORS	EVAPORATOR			CONDENSER/RECOVERY			DESUPERHEATER
	ff (m ² °CW)	F1	FK1	KE [°C]	F2	FK2	KC [°C]	R3
VARIOUS	0	1,000	1,000	0,0	1,000	1,000	0,0	1,000
VARIOUS	1,80 x 10 ⁻⁵	1,000	1,000	0,0	1,000	1,000	0,0	1,000
VARIOUS	4,40 x 10 ⁻⁵	1,000	1,000	0,0	0,990	1,030	1,0	0,990
VARIOUS	8,80 x 10 ⁻⁵	0,960	0,990	0,7	0,980	1,040	1,5	0,980
VARIOUS	13,20 x 10 ⁻⁵	0,944	0,985	1,0	0,964	1,050	2,3	0,964
VARIOUS	17,20 x 10 ⁻⁵	0,930	0,980	1,5	0,950	1,060	3,0	0,950

ff: fouling factors
 F1 - F2: potential correction factors
 FK1 - FK2: compressor power input correction factors
 R3: capacity correction factors
 KE: minimum evaporator outlet temperature increase
 KC: maximum condenser outlet temperature decrease


OPERATING LIMITS

OPERATION LIMITS OF DE-SUPERHEATERS

If it isn't possible to guarantee the indicated minimum temperatures, it is wise to install a dedicated kit for protection of de-superheater (device subject to RFQ - request feasibility and quotation) (see figure).

De-superheater minimum inlet temperature = 25°C

De-superheater minimum outlet temperature = 30°C

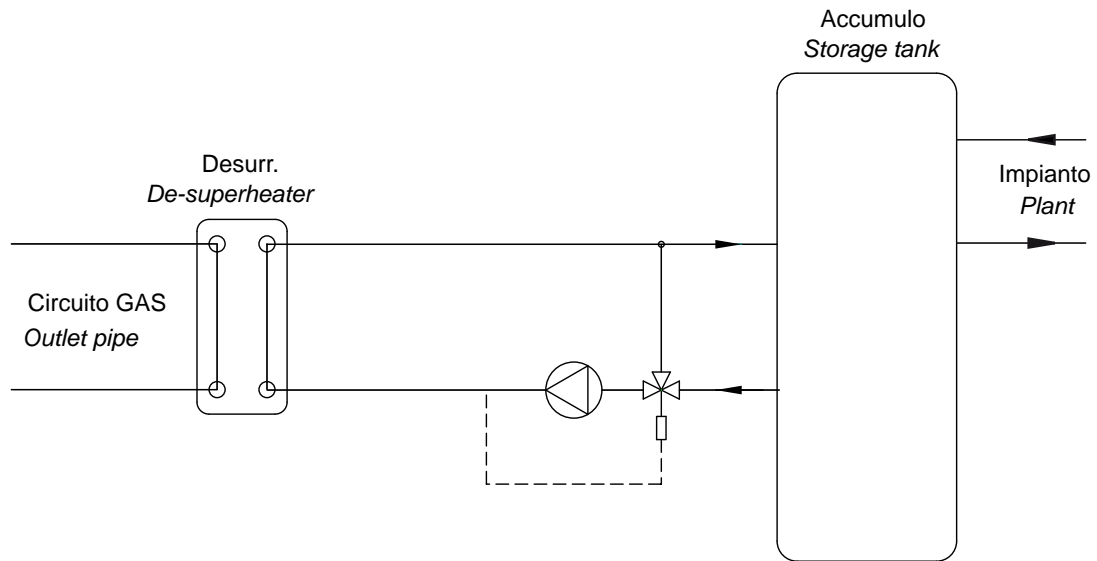

6.1 HYDRAULIC DATA

[SI System]

Water flow and pressure drop

Water flow in the plant (side) exchanger is given by:

$$Q = P / (4,186 \times Dt)$$

Q: water flow (l/s)

Dt: difference between inlet and outlet water temp. (°C)

P: heat exchanger capacity (kW)

Pressure drop is given by:

$$Dp = K \times (3,6 \times Q)^2 / 1000$$

Q: water flow (l/s)

Dp: pressure drop (kPa)

K: unit size ratio

SIZE	Power supply V/ph/Hz	HEAT EXCHANGER USER SIDE					HEAT RECOVERY EX. USER SIDE			
		K	Q min l/s	Q max l/s	C.A.S. l	C.a. min l	K	Q min l/s	Q max l/s	C.A.S. l
FR-G05-Z /K /0751	400/3/50	32,8	1,528	23,06	20,1	700	-	-	-	-
FR-G05-Z /K /0851	400/3/50	26,5	1,833	23,06	24,6	800	-	-	-	-
FR-G05-Z /K /0951	400/3/50	24,8	6,389	14,72	90,0	1000	-	-	-	-
FR-G05-Z /K /0961	400/3/50	24,8	6,389	14,72	90,0	1100	-	-	-	-
FR-G05-Z /K /1101	400/3/50	24,8	6,389	14,72	90,0	1200	-	-	-	-
FR-G05-Z /K /1301	400/3/50	19,0	7,222	16,67	85,0	1400	-	-	-	-
FR-G05-Z /K /1401	400/3/50	19,0	7,222	16,67	85,0	1500	-	-	-	-
FR-G05-Z /K /1421	400/3/50	14,0	8,333	19,44	80,0	1600	-	-	-	-
FR-G05-Z /K /1431	400/3/50	8,23	9,167	26,94	116	1700	-	-	-	-
FR-G05-Z /K /1801	400/3/50	8,23	9,167	26,94	116	2000	-	-	-	-
FR-G05-Z /D /K /0751	400/3/50	32,8	1,528	23,06	20,1	700	588	0,003	2,278	1,60
FR-G05-Z /D /K /0851	400/3/50	26,5	1,833	23,06	24,6	800	588	0,003	2,694	1,60
FR-G05-Z /D /K /0951	400/3/50	24,8	6,389	14,72	90,0	1000	588	0,003	2,833	1,60
FR-G05-Z /D /K /0961	400/3/50	24,8	6,389	14,72	90,0	1100	292	0,003	3,306	2,20
FR-G05-Z /D /K /1101	400/3/50	24,8	6,389	14,72	90,0	1200	292	0,003	3,889	2,20
FR-G05-Z /D /K /1301	400/3/50	19,0	7,222	16,67	85,0	1400	292	0,003	3,944	2,20
FR-G05-Z /D /K /1401	400/3/50	19,0	7,222	16,67	85,0	1500	144	0,003	4,667	2,90
FR-G05-Z /D /K /1421	400/3/50	14,0	8,333	19,44	80,0	1600	144	0,003	5,444	2,90
FR-G05-Z /D /K /1431	400/3/50	8,23	9,167	26,94	116	1700	144	0,003	5,000	2,90
FR-G05-Z /D /K /1801	400/3/50	8,23	9,167	26,94	116	2000	84,0	0,003	6,167	4,50
FR-G05-Z /R /K /0751	400/3/50	32,8	1,528	23,06	20,1	700	27,3	1,611	23,06	21,4
FR-G05-Z /R /K /0851	400/3/50	26,5	1,833	23,06	24,6	800	21,8	1,861	23,06	24,2
FR-G05-Z /R /K /0951	400/3/50	24,8	6,389	14,72	90,0	1000	15,2	7,500	17,22	26,0
FR-G05-Z /R /K /0961	400/3/50	24,8	6,389	14,72	90,0	1100	12,4	8,889	20,00	29,4
FR-G05-Z /R /K /1101	400/3/50	24,8	6,389	14,72	90,0	1200	10,0	10,00	22,78	32,9
FR-G05-Z /R /K /1301	400/3/50	19,0	7,222	16,67	85,0	1400	10,0	10,00	22,78	32,9
FR-G05-Z /R /K /1401	400/3/50	19,0	7,222	16,67	85,0	1500	7,80	12,22	28,06	39,8
FR-G05-Z /R /K /1421	400/3/50	14,0	8,333	19,44	80,0	1600	6,70	13,61	31,39	45,0
FR-G05-Z /R /K /1431	400/3/50	8,23	9,167	26,94	116	1700	6,70	13,61	31,39	45,0
FR-G05-Z /R /K /1801	400/3/50	8,23	9,167	26,94	116	2000	3,40	18,89	43,33	54,4
FR-G05-Z /SL-K /0751	400/3/50	32,8	1,528	23,06	20,1	700	-	-	-	-
FR-G05-Z /SL-K /0851	400/3/50	26,5	1,833	23,06	24,6	800	-	-	-	-
FR-G05-Z /SL-K /0951	400/3/50	24,8	6,389	14,72	90,0	1000	-	-	-	-
FR-G05-Z /SL-K /0961	400/3/50	24,8	6,389	14,72	90,0	1100	-	-	-	-
FR-G05-Z /SL-K /1101	400/3/50	24,8	6,389	14,72	90,0	1200	-	-	-	-
FR-G05-Z /SL-K /1301	400/3/50	19,0	7,222	16,67	85,0	1400	-	-	-	-
FR-G05-Z /SL-K /1401	400/3/50	19,0	7,222	16,67	85,0	1500	-	-	-	-
FR-G05-Z /SL-K /1421	400/3/50	14,0	8,333	19,44	80,0	1600	-	-	-	-
FR-G05-Z /SL-K /1431	400/3/50	8,23	9,167	26,94	116	1700	-	-	-	-
FR-G05-Z /SL-K /1801	400/3/50	8,23	9,167	26,94	116	2000	-	-	-	-
FR-G05-Z /D /SL-K /0751	400/3/50	32,8	1,528	23,06	20,1	700	588	0,003	2,333	1,60

Q min: minimum water flow admitted to the heat exchanger
 Q max: maximum water flow admitted to the heat exchanger
 C.a. min: minimum water content admitted in the plant
 C.A.S.: Exchanger water content

HYDRAULIC DATA

[SI System]

SIZE	Power supply V/ph/Hz	HEAT EXCHANGER USER SIDE					HEAT RECOVERY EX. USER SIDE			
		K	Q min l/s	Q max l/s	C.A.S. l	C.a. min l	K	Q min l/s	Q max l/s	C.A.S. l
FR-G05-Z /D /SL-K /0851	400/3/50	26,5	1,833	23,06	24,6	800	588	0,003	2,444	1,60
FR-G05-Z /D /SL-K /0951	400/3/50	24,8	6,389	14,72	90,0	1000	588	0,003	2,944	1,60
FR-G05-Z /D /SL-K /0961	400/3/50	24,8	6,389	14,72	90,0	1100	292	0,003	3,472	2,20
FR-G05-Z /D /SL-K /1101	400/3/50	24,8	6,389	14,72	90,0	1200	292	0,003	3,667	2,20
FR-G05-Z /D /SL-K /1301	400/3/50	19,0	7,222	16,67	85,0	1400	292	0,003	4,083	2,20
FR-G05-Z /D /SL-K /1401	400/3/50	19,0	7,222	16,67	85,0	1500	144	0,003	4,861	2,90
FR-G05-Z /D /SL-K /1421	400/3/50	14,0	8,333	19,44	80,0	1600	144	0,003	5,167	2,90
FR-G05-Z /D /SL-K /1431	400/3/50	8,23	9,167	26,94	116	1700	144	0,003	4,861	2,90
FR-G05-Z /D /SL-K /1801	400/3/50	8,23	9,167	26,94	116	2000	84,0	0,003	6,056	4,50
FR-G05-Z /R /SL-K /0751	400/3/50	32,8	1,528	23,06	20,1	700	27,3	1,528	23,06	21,4
FR-G05-Z /R /SL-K /0851	400/3/50	26,5	1,833	23,06	24,6	800	21,8	1,833	23,06	24,2
FR-G05-Z /R /SL-K /0951	400/3/50	24,8	6,389	14,72	90,0	1000	15,2	7,500	17,22	26,0
FR-G05-Z /R /SL-K /0961	400/3/50	24,8	6,389	14,72	90,0	1100	12,4	8,889	20,00	29,4
FR-G05-Z /R /SL-K /1101	400/3/50	24,8	6,389	14,72	90,0	1200	10,0	10,00	22,78	32,9
FR-G05-Z /R /SL-K /1301	400/3/50	19,0	7,222	16,67	85,0	1400	10,0	10,00	22,78	32,9
FR-G05-Z /R /SL-K /1401	400/3/50	19,0	7,222	16,67	85,0	1500	7,80	12,22	28,06	39,8
FR-G05-Z /R /SL-K /1421	400/3/50	14,0	8,333	19,44	80,0	1600	6,70	13,61	31,39	45,0
FR-G05-Z /R /SL-K /1431	400/3/50	8,23	9,167	26,94	116	1700	6,70	13,61	31,39	45,0
FR-G05-Z /R /SL-K /1801	400/3/50	8,23	9,167	26,94	116	2000	3,40	18,89	43,33	54,4

Q min: minimum water flow admitted to the heat exchanger
 Q max: maximum water flow admitted to the heat exchanger
 C.a. min: minimum water content admitted in the plant
 C.A.S.: Exchanger water content

7.1 ELECTRICAL DATA

FR-G05-Z /K

[SI System]

SIZE	Power supply V/ph/Hz	Maximum values								
		n	Compressor			Fans (1)		Total (1)(2)		
			F.L.I. [kW]	F.L.A. [A]	L.R.A. [A]	F.L.I. [kW]	F.L.A. [A]	F.L.I. [kW]	F.L.A. [A]	S.A. [A]
0751	400/3/50	1	62,7	102,3	303	2,000	4	67,00	110	311
0851	400/3/50	1	71,1	116,2	350	2,000	4	75,00	124	358
0951	400/3/50	1	80,9	129,8	423	2,000	4	87,00	141	434
0961	400/3/50	1	80,9	129,8	423	2,000	4	87,00	141	434
1101	400/3/50	1	99,9	163,4	300	2,000	4	106,0	175	311
1301	400/3/50	1	112,3	184,7	360	2,000	4	120,0	200	375
1401	400/3/50	1	127,8	209	404	2,000	4	136,0	224	419
1421	400/3/50	1	127,8	209	404	2,000	4	136,0	224	419
1431	400/3/50	1	127,8	209	404	2,000	4	138,0	228	423
1801	400/3/50	1	161,7	258	465	2,000	4	172,0	277	484

F.L.I.: Full load power

F.L.A.: Full load current

L.R.A.: Locked rotor amperes for single compressor

S.A.: Inrush current

(1) Values calculated referring to the version with the maximum number of fans working at the max absorbed current

(1)(2) Safety values to be considered when cabling the unit for power supply and line-protections

Data valid for standard units without any additional option.

Plant (side) cooling exchanger water (in/out) 12,00°C/7,00°C; Source (side) heat exchanger air (in) 35,0°C.

Voltage tolerance: 10%

Maximum voltage unbalance: 3%

Give the typical operating conditions of units designed for outdoor installation, which can be associated (according to reference document IEC 60721) to the following classes:

- climatic conditions class 4K4H: air temperature range from -20 up to 55°C (*), relative humidity range from 4 up to 100%, with possible precipitations, at air pressure from 70 and 106 kPa and a maximum solar radiation of 1120 W/m²

- special climatic conditions negligible

- biological conditions class 4B1 and 4C2: locations in a generic urban area

- mechanically active substances class 4S2: locations in areas with sand or dust representative of urban areas

- mechanical conditions class 4M1: locations protected from significant vibrations or shocks

The required protection level for safe operation, according to reference document IEC 60529, is IP43XW (protection against access, to the most critical unit's parts, of external devices with diameter larger than 1 mm and rain).

The unit can be considered IP44XW protected, i.e. protected against access of external devices (with diameter larger than 1 mm) and water in general.

(*) for the unit's operating limits, see "selection limits" section

ELECTRICAL DATA

FR-G05-Z /SL-K

[SI System]

SIZE	Power supply V/ph/Hz	Maximum values								
		Compressor			Fans (1)		Total (1)(2)			
		n	F.L.I. [kW]	F.L.A. [A]	L.R.A. [A]	F.L.I. [kW]	F.L.A. [A]	F.L.I. [kW]	F.L.A. [A]	S.A. [A]
0751	400/3/50	1	62,7	102,3	303	2,000	4	67,00	110	311
0851	400/3/50	1	71,1	116,2	350	2,000	4	77,00	128	361
0951	400/3/50	1	80,9	129,8	423	2,000	4	87,00	141	434
0961	400/3/50	1	80,9	129,8	423	2,000	4	87,00	141	434
1101	400/3/50	1	99,9	163,4	300	2,000	4	108,0	179	315
1301	400/3/50	1	112,3	184,7	360	2,000	4	120,0	200	375
1401	400/3/50	1	127,8	209	404	2,000	4	136,0	224	419
1421	400/3/50	1	127,8	209	404	2,000	4	138,0	228	423
1431	400/3/50	1	127,8	209	404	2,000	4	140,0	232	427
1801	400/3/50	1	161,7	258	465	2,000	4	174,0	281	488

F.L.I.: Full load power

F.L.A.: Full load current

L.R.A.: Locked rotor amperes for single compressor

S.A.: Inrush current

(1) Values calculated referring to the version with the maximum number of fans working at the max absorbed current

(1)(2) Safety values to be considered when cabling the unit for power supply and line-protections

Data valid for standard units without any additional option.

Plant (side) cooling exchanger water (in/out) 12,00°C/7,00°C; Source (side) heat exchanger air (in) 35,0°C.

Voltage tolerance: 10%

Maximum voltage unbalance: 3%

Give the typical operating conditions of units designed for outdoor installation, which can be associated (according to reference document IEC 60721) to the following classes:

- climatic conditions class 4K4H: air temperature range from -20 up to 55°C (*), relative humidity range from 4 up to 100%, with possible precipitations, at air pressure from 70 and 106 kPa and a maximum solar radiation of 1120 W/m²
- special climatic conditions negligible
- biological conditions class 4B1 and 4C2: locations in a generic urban area
- mechanically active substances class 4S2: locations in areas with sand or dust representative of urban areas
- mechanical conditions class 4M1: locations protected from significant vibrations or shocks

The required protection level for safe operation, according to reference document IEC 60529, is IP43XW (protection against access, to the most critical unit's parts, of external devices with diameter larger than 1 mm and rain).

The unit can be considered IP44XW protected, i.e. protected against access of external devices (with diameter larger than 1 mm) and water in general.

(*) for the unit's operating limits, see "selection limits" section

ELECTRICAL DATA

MAXIMUM CABLES/BARS SECTION CONNECTED TO MAIN SWITCH AND SHORT TIME CURRENT STANDARD UNITS

Unit size (all versions)	Main switch type (category AC-23A/B)	Cable section	Bar dimensions	Maximum back-up fuse rating	ICW (0,25s) Short time current rms	Further technical data
		∅ [mm ²]	□ [mm]	[A]	[kA]	
751	VC2P 250A	120	20 x 5	250	15	http://www.technoelectric.it/ing/VCP_tab_dati_ing.html
851						
951						
961						
1101						
1301						
1401	VC3P 400A	240	2 x 25 x 5	400	25	
1421						
1431						
1801						

Electrical data valid for standard units without any additional option

Voltage tolerance: 10%
Maximum voltage unbalance: 3%

MAXIMUM CABLES/BARS SECTION CONNECTED TO MAIN SWITCH AND SHORT TIME CURRENT UNITS WITH Kit HT (Code 1955)

Unit size (all versions)	Main switch type (category AC-23A/B)	Cable section	Bar dimensions	Maximum back-up fuse rating	ICW (0,25s) Short time current rms	Further technical data
		∅ [mm ²]	□ [mm]	[A]	[kA]	
751	VC2P 250A	120	20 x 5	250	15	http://www.technoelectric.it/ing/VCP_tab_dati_ing.html
851						
951						
961						
1101						
1301	VC3P 400A	240	2 x 25 x 5	400	25	
1401						
1421						
1431						
1801						

Voltage tolerance: 10%
Maximum voltage unbalance: 3%

8.1 FULL LOAD SOUND LEVEL

FR-G05-Z /K

SOUND POWER LEVEL IN COOLING									
SIZE	Octave band [Hz]								Total sound level dB(A)
	63	125	250	500	1000	2000	4000	8000	
	Sound power level dB								
0751	88	94	94	90	91	83	81	72	94
0851	88	94	94	90	91	83	81	72	94
0951	88	94	94	90	91	83	81	72	94
0961	88	94	94	90	91	83	81	72	94
1101	90	96	96	92	93	85	83	74	96
1301	90	96	96	92	93	85	83	74	96
1401	91	97	97	93	94	86	84	75	97
1421	92	98	98	94	95	87	85	76	98
1431	92	98	98	94	95	87	85	76	98
1801	92	98	98	94	95	87	85	76	98

Working conditions

Plant (side) cooling exchanger water (in/out) 12,00°C/7,00°C; Source (side) heat exchanger air (in) 35,0°C.

Sound power on the basis of measurements made in compliance with ISO 9614.

Such certification refers specifically to the sound Power Level in dB(A). This is therefore the only acoustic data to be considered as binding.

Sound power level in cooling, outdoors.

SOUND PRESSURE LEVEL									
SIZE	Octave band [Hz]								Total sound level dB(A)
	63	125	250	500	1000	2000	4000	8000	
	Sound pressure level dB								
0751	56	62	62	58	59	51	49	40	62
0851	56	62	62	58	59	51	49	40	62
0951	56	62	62	58	59	51	49	40	62
0961	56	62	62	58	59	51	49	40	62
1101	58	64	64	60	61	53	51	42	64
1301	58	64	64	60	61	53	51	42	64
1401	59	65	65	61	62	54	52	43	65
1421	60	66	66	62	63	55	53	44	66
1431	60	66	66	62	63	55	53	44	66
1801	60	66	66	62	63	55	53	44	66

Working conditions

Plant (side) cooling exchanger water (in/out) 12,00°C/7,00°C; Source (side) heat exchanger air (in) 35,0°C.

Average sound pressure level at 10m distance, unit in a free field on a reflective surface; non-binding value calculated from the sound power level.

FULL LOAD SOUND LEVEL

FR-G05-Z /SL-K

SOUND POWER LEVEL IN COOLING									
SIZE	Octave band [Hz]								Total sound level dB(A)
	63	125	250	500	1000	2000	4000	8000	
	Sound power level dB								
0751	88	85	88	82	76	72	70	62	84
0851	88	85	88	82	76	72	70	62	84
0951	89	86	89	83	77	73	71	63	85
0961	89	86	89	83	77	73	71	63	85
1101	91	88	91	85	79	75	73	65	87
1301	91	88	91	85	79	75	73	65	87
1401	92	89	92	86	80	76	74	66	88
1421	93	90	93	87	81	77	75	67	89
1431	93	90	93	87	81	77	75	67	89
1801	93	90	93	87	81	77	75	67	89

Working conditions

Plant (side) cooling exchanger water (in/out) 12,00°C/7,00°C; Source (side) heat exchanger air (in) 35,0°C.

Sound power on the basis of measurements made in compliance with ISO 9614.

Such certification refers specifically to the sound Power Level in dB(A). This is therefore the only acoustic data to be considered as binding.




Sound power level in cooling, outdoors.

SOUND PRESSURE LEVEL									
SIZE	Octave band [Hz]								Total sound level dB(A)
	63	125	250	500	1000	2000	4000	8000	
	Sound pressure level dB								
0751	56	53	56	50	44	40	38	30	52
0851	56	53	56	50	44	40	38	30	52
0951	57	54	57	51	45	41	39	31	53
0961	57	54	57	51	45	41	39	31	53
1101	59	56	59	53	47	43	41	33	55
1301	59	56	59	53	47	43	41	33	55
1401	60	57	60	54	48	44	42	34	56
1421	61	58	61	55	49	45	43	35	57
1431	61	58	61	55	49	45	43	35	57
1801	61	58	61	55	49	45	43	35	57

Working conditions


Plant (side) cooling exchanger water (in/out) 12,00°C/7,00°C; Source (side) heat exchanger air (in) 35,0°C.

Average sound pressure level at 10m distance, unit in a free field on a reflective surface; non-binding value calculated from the sound power level.

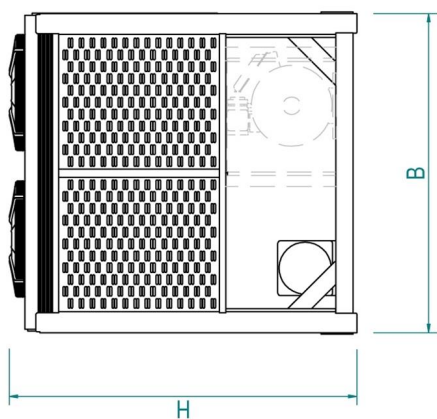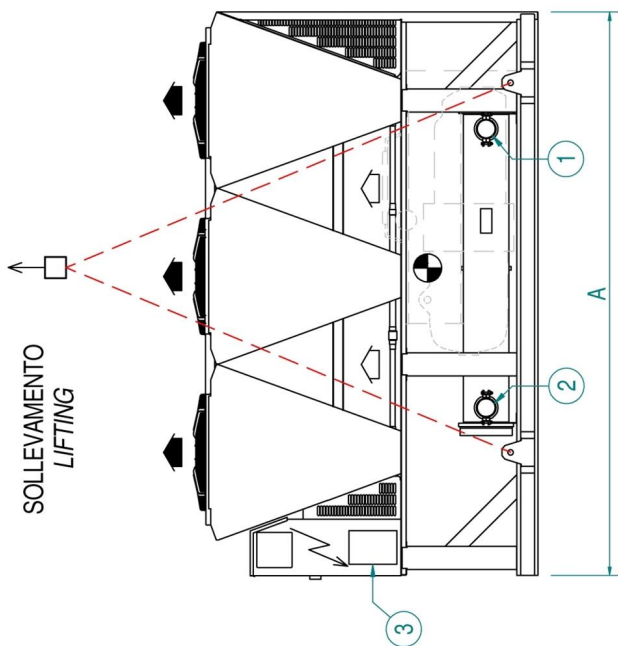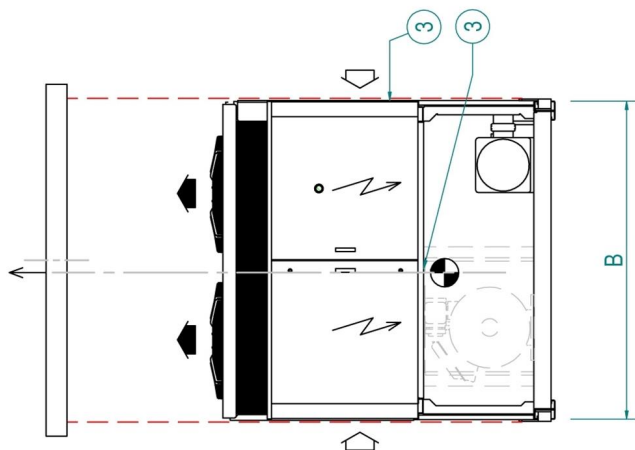

- ENTRATA ARIA
AIR INLET
- USCITA ARIA
AIR OUTLET
- BARICENTRO
CENTER OF GRAVITY

- ① ENTRATA ACQUA EVAPORATORE
EVAPORATOR WATER INLET
- ② USCITA ACQUA EVAPORATORE
EVAPORATOR WATER OUTLET
- ③ INGRESSO LINEA ELETTRICA
POWER INLET

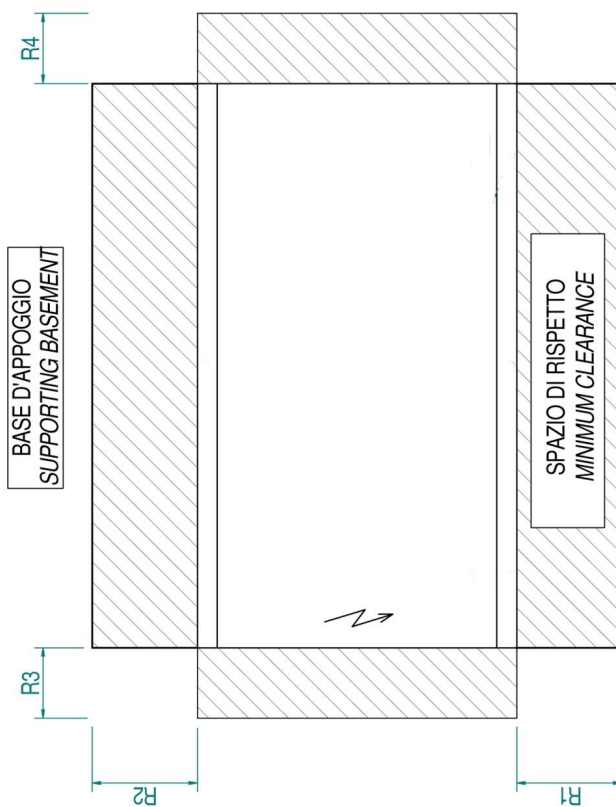

REMARKS: For installation purposes, please refer to the documentation sent after the purchase contract. This technical data should be considered as indicative. Mitsubishi Electric Hydronics & IT Cooling Systems S.p.A. may modify them at any moment. Data valid for standard units without any additional option.

DIMENSIONAL DRAWINGS

FR-G05-Z 0751 - 1801

[SI System]

SIZE	DIMENSIONS AND WEIGHTS				CLEARANCE				HEAT EXCHANGER USER SIDE		HEAT RECOVERY EX. USER SIDE	
	A	B	H	WEIGHT	R1	R2	R3	R4	IN/OUT		IN/OUT	
	[mm]	[mm]	[mm]	[kg]	[mm]	[mm]	[mm]	[mm]	TYPE	Ø	TYPE	Ø
FR-G05-Z /K /0751	1500	2260	2500	1480	2000	2300	1500	1500	H	3"	-	-
FR-G05-Z /K /0851	1500	2260	2500	1510	2000	2300	1500	1500	H	3"	-	-
FR-G05-Z /K /0951	2750	2260	2500	2100	2000	2300	1500	1500	H	4"	-	-
FR-G05-Z /K /0961	2750	2260	2500	2130	2000	2300	1500	1500	H	4"	-	-
FR-G05-Z /K /1101	2750	2260	2500	2460	2000	2300	1500	1500	H	4"	-	-
FR-G05-Z /K /1301	2750	2260	2500	2510	2000	2300	1500	1500	H	4"	-	-
FR-G05-Z /K /1401	2750	2260	2500	2540	2000	2300	1500	1500	H	4"	-	-
FR-G05-Z /K /1421	2750	2260	2500	2580	2000	2300	1500	1500	H	4"	-	-
FR-G05-Z /K /1431	4000	2260	2500	3110	2000	2300	1500	1500	H	5"	-	-
FR-G05-Z /K /1801	4000	2260	2500	3540	2000	2300	1500	1500	H	5"	-	-
FR-G05-Z /D /K /0751	1500	2260	2500	1524	2000	2300	1500	1500	H	3"	F	2"
FR-G05-Z /D /K /0851	1500	2260	2500	1555	2000	2300	1500	1500	H	3"	F	2"
FR-G05-Z /D /K /0951	2750	2260	2500	2163	2000	2300	1500	1500	H	4"	F	2"
FR-G05-Z /D /K /0961	2750	2260	2500	2194	2000	2300	1500	1500	H	4"	F	2"
FR-G05-Z /D /K /1101	2750	2260	2500	2534	2000	2300	1500	1500	H	4"	F	2"
FR-G05-Z /D /K /1301	2750	2260	2500	2585	2000	2300	1500	1500	H	4"	F	2"
FR-G05-Z /D /K /1401	2750	2260	2500	2616	2000	2300	1500	1500	H	4"	F	2"
FR-G05-Z /D /K /1421	2750	2260	2500	2657	2000	2300	1500	1500	H	4"	F	2"
FR-G05-Z /D /K /1431	4000	2260	2500	3203	2000	2300	1500	1500	H	5"	F	2"
FR-G05-Z /D /K /1801	4000	2260	2500	3646	2000	2300	1500	1500	H	5"	F	2 1/2"
FR-G05-Z /R /K /0751	1500	2260	2500	1620	2000	2300	1500	1500	H	2"1/2	H	3"
FR-G05-Z /R /K /0851	1500	2260	2500	1660	2000	2300	1500	1500	H	2"1/2	H	3"
FR-G05-Z /R /K /0951	3250	2260	2500	2490	2000	2300	1500	1500	H	4"	I	3"
FR-G05-Z /R /K /0961	3250	2260	2500	2520	2000	2300	1500	1500	H	4"	I	3"
FR-G05-Z /R /K /1101	3250	2260	2500	2870	2000	2300	1500	1500	H	4"	I	3"
FR-G05-Z /R /K /1301	3250	2260	2500	2920	2000	2300	1500	1500	H	4"	I	3"
FR-G05-Z /R /K /1401	3250	2260	2500	2970	2000	2300	1500	1500	H	4"	I	3"
FR-G05-Z /R /K /1421	3250	2260	2500	3020	2000	2300	1500	1500	H	4"	I	3"
FR-G05-Z /R /K /1431	4500	2260	2500	3480	2000	2300	1500	1500	H	5"	I	3"
FR-G05-Z /R /K /1801	4500	2260	2500	4020	2000	2300	1500	1500	H	5"	H	4"
FR-G05-Z /SL-K /0751	1500	2260	2500	1640	2000	2300	1500	1500	H	3"	-	-
FR-G05-Z /SL-K /0851	2750	2260	2500	2050	2000	2300	1500	1500	H	3"	-	-
FR-G05-Z /SL-K /0951	2750	2260	2500	2270	2000	2300	1500	1500	H	4"	-	-
FR-G05-Z /SL-K /0961	2750	2260	2500	2290	2000	2300	1500	1500	H	4"	-	-
FR-G05-Z /SL-K /1101	2750	2260	2500	2770	2000	2300	1500	1500	H	4"	-	-
FR-G05-Z /SL-K /1301	2750	2260	2500	2770	2000	2300	1500	1500	H	4"	-	-
FR-G05-Z /SL-K /1401	2750	2260	2500	2790	2000	2300	1500	1500	H	4"	-	-
FR-G05-Z /SL-K /1421	4000	2260	2500	3250	2000	2300	1500	1500	H	4"	-	-
FR-G05-Z /SL-K /1431	4000	2260	2500	3410	2000	2300	1500	1500	H	5"	-	-
FR-G05-Z /SL-K /1801	4000	2260	2500	3880	2000	2300	1500	1500	H	5"	-	-
FR-G05-Z /D /SL-K /0751	1500	2260	2500	1689	2000	2300	1500	1500	H	3"	F	2"
FR-G05-Z /D /SL-K /0851	2750	2260	2500	2112	2000	2300	1500	1500	H	3"	F	2"
FR-G05-Z /D /SL-K /0951	2750	2260	2500	2338	2000	2300	1500	1500	H	4"	F	2"
FR-G05-Z /D /SL-K /0961	2750	2260	2500	2359	2000	2300	1500	1500	H	4"	F	2"
FR-G05-Z /D /SL-K /1101	2750	2260	2500	2853	2000	2300	1500	1500	H	4"	F	2"
FR-G05-Z /D /SL-K /1301	2750	2260	2500	2853	2000	2300	1500	1500	H	4"	F	2"
FR-G05-Z /D /SL-K /1401	2750	2260	2500	2874	2000	2300	1500	1500	H	4"	F	2"
FR-G05-Z /D /SL-K /1421	4000	2260	2500	3348	2000	2300	1500	1500	H	4"	F	2"
FR-G05-Z /D /SL-K /1431	4000	2260	2500	3512	2000	2300	1500	1500	H	5"	F	2"
FR-G05-Z /D /SL-K /1801	4000	2260	2500	3996	2000	2300	1500	1500	H	5"	F	2 1/2"
FR-G05-Z /R /SL-K /0751	1500	2260	2500	1780	2000	2300	1500	1500	H	2"1/2	H	3"
FR-G05-Z /R /SL-K /0851	2750	2260	2500	2200	2000	2300	1500	1500	H	2"1/2	H	3"

DIMENSIONAL DRAWINGS

FR-G05-Z 0751 - 1801

[SI System]

SIZE	DIMENSIONS AND WEIGHTS				CLEARANCE				HEAT EXCHANGER USER SIDE		HEAT RECOVERY EX. USER SIDE	
	A	B	H	WEIGHT	R1	R2	R3	R4	IN/OUT		IN/OUT	
	[mm]	[mm]	[mm]	[kg]	[mm]	[mm]	[mm]	[mm]	TYPE	Ø	TYPE	Ø
FR-G05-Z /R /SL-K /0951	3250	2260	2500	2650	2000	2300	1500	1500	H	4"	I	3"
FR-G05-Z /R /SL-K /0961	3250	2260	2500	2680	2000	2300	1500	1500	H	4"	I	3"
FR-G05-Z /R /SL-K /1101	3250	2260	2500	3180	2000	2300	1500	1500	H	4"	I	3"
FR-G05-Z /R /SL-K /1301	3250	2260	2500	3180	2000	2300	1500	1500	H	4"	I	3"
FR-G05-Z /R /SL-K /1401	3250	2260	2500	3230	2000	2300	1500	1500	H	4"	I	3"
FR-G05-Z /R /SL-K /1421	4500	2260	2500	3620	2000	2300	1500	1500	H	4"	I	3"
FR-G05-Z /R /SL-K /1431	4500	2260	2500	3790	2000	2300	1500	1500	H	5"	I	3"
FR-G05-Z /R /SL-K /1801	4500	2260	2500	4370	2000	2300	1500	1500	H	5"	H	4"

DIMENSIONAL DRAWINGS

LEGEND OF PIPE CONNECTIONS



TYPE = F

Grooved coupling with male threaded counter-pipe user side

TYPE = H

Grooved coupling with weld end counter-pipe user side

TYPE = I

Female threaded connection with weld end counter-pipe user side

UNI ISO 228/13

Pipe threads where pressure-tight joints are not made on the threads - Designation, dimensions and tolerances

Used terminology:

G: Pipe threads where pressure-tight joints are not made on the threads

A: Close tolerance class for external pipe threads where pressure-tight joints are not made on the threads

B: Wider tolerance class for external pipe threads where pressure-tight joints are not made on the threads

Internal threads: G letter followed by thread mark (only tolerance class)

External threads: G letter followed by thread mark and by A letter for A class external threads or by B letter for B class external threads.

UNI EN 10226-1

Pipe threads where pressure-tight joints are made on the threads - Designation, dimensions and tolerances

Used terminology:

Rp: Internal cylindrical threads where pressure-tight joints are made on the threads

Rc: Internal conical threads where pressure-tight joints are made on the threads

R: External conical threads where pressure-tight joints are made on the threads

Internal cylindrical threads: R letter followed by p letter

Internal conical threads: R letter followed by c letter

External conical threads: R letter

NOMINAL PIPE SIZE	PIPE OUTSIDE DIAMETER	NOMINAL PIPE SIZE	PIPE OUTSIDE DIAMETER
ø inches	ø mm	ø inches	ø mm
¾	26,7	4	114,3
1	33,7	4 ½	127,0
1 ¼	42,4	5	139,7
1 ½	48,3	6	168,3
2	60,3	8	219,1
2 ½	76,1	10	273,0
3	88,9	12	323,9
3 ½	101,6	14	355,6

DESIGNATION	DESCRIPTION
UNI EN 10226-1 - Rp 1 1/2	Internal cylindrical threads where pressure-tight joints are made on the threads, defined by standard UNI ISO 7/1 Conventional ø 1 1/2"
UNI EN 10226-1 - Rp 2 1/2	Internal cylindrical threads where pressure-tight joints are made on the threads, defined by standard UNI ISO 7/1 Conventional ø 2 1/2"
UNI EN 10226-1 - Rp 3	Internal cylindrical threads where pressure-tight joints are made on the threads, defined by standard UNI ISO 7/1 Conventional ø 3"
UNI EN 10226-1 - R 3	External conical threads where pressure-tight joints are made on the threads, defined by standard UNI ISO 7/1 Conventional ø 3"
UNI ISO 228/1 - G 4 B	Internal cylindrical threads where pressure-tight joints are not made on the threads, defined by standard UNI ISO 228/1 Tolerance class B for external thread Conventional ø 4"
DN 80 PN 16	Flange Nominal Diameter: 80 mm Nominal Pressure: 16 bar

NOTE:

Conventional diameter value [in inches] identifies short thread designation, based upon the relative standard.

All relative values are defined by standards.

As example, here below some values:

	UNI EN 10226-1	UNI ISO 228/1
Conventional ø	1"	1"
Pitch	2.309 mm	2.309 mm
External ø	33.249 mm	33.249 mm
Core ø	30.291 mm	30.291 mm
Thread height	1.479 mm	1.479 mm

10.1 HYDRONIC GROUP

10.1 HYDRONIC MODULE

The units can be fitted with the following types hydronic module:

- Only terminals (ON/OFF or modulating)

The hydronic module allows to control the external pumps with the unit controller logic.

- Pumps (fixed or variable speed)

The hydronic module includes the pumps and the main water circuit components, thus optimizing hydraulic and electrical installation space, time and costs.

The complete list of the options available is present in the accessory section of the bulletin.

For the hydronic modules with only terminals, the factory-mounted components are:

- Terminals for external pumps control (only relays or relays + 0-10V signal)
- Differential pressure switch (on heat exchanger)
- Drain valve (on heat exchanger)

For the hydronic modules with pumps, the factory-mounted components are:

- 1 or 2 pumps, 2 poles, low or high head, fixed speed or variable speed (inverter)
- Pump suction and discharge valves
- One-way valve (Clapet type for in-line pumps)
- Purge valve
- Drain plug
- Differential pressure switch (on heat exchanger)
- Drain valve (on heat exchanger)

In the modules with 2 pumps, they are controlled in duty/standby, with running hours equalization and changeover on device failure.

The electrical panel of the unit is protected with fuses and contactors with thermals cut-out.

Suction, volute and discharge of each pump and all the water pipes are covered with an insulation lining in closed-cell reticulated foam in PE of 15 mm.

The hydronic group is protected by a self-ventilated enclosure. In silenced units (/SL versions and units with Noise Reducer (code 2315)), the enclosure is acoustically insulated by a 30 mm thick lining of polyester fibers (Fiberform).

Note: the use of 2 pole pumps in super low noise units (/SL versions) increases the sound power by 1 dB(A).

The choice between in-line and end-suction pumps has been made keeping in consideration the best configuration in terms of dimensions and performances.

10.1 IN-LINE PUMPS

Low or high head pumps

Grundfos single-stage, close-coupled, volute twin-head pump with in-line suction and discharge ports. The pump housing and the impeller are made of cast iron, with optimized design to improve the efficiency. The twin-head pumps are designed with two parallel power heads. Each power head is fitted with a fan-cooled asynchronous motor of identical size. Motor and pump shafts are connected via a rigid two-part coupling. The pumps are of the top-pull-out design, i.e. you can remove the power head (motor, pump head and impeller) for maintenance or service while the pump housing remains in the pipework.

Pump housing and pump head are electrocoated to improve the corrosion resistance. The flanges have tappings for mounting of pressure gauges. The central part of the motor stool is provided with guards for protection against the shaft and coupling.

The shaft seal is in accordance with EN 12756. Pipework connection is via PN 16 DIN flanges (EN 1092-2 and ISO 7005-2).

The pump is fitted with an unbalanced rubber bellows seal with torque transmission across the spring and around the bellows. Due to the bellows, the seal does not wear the shaft, and the axial movement is not prevented by deposits on the shaft.

Primary seal:

- Rotating seal ring material: Silicon carbide (SiC)
- Stationary seat material: Silicon carbide (SiC)

This material pairing is used where higher corrosion resistance is required. The high hardness of this material pairing offers good resistance against abrasive particles.

Secondary seal material: EPDM (ethylene-propylene rubber). EPDM has excellent resistance to hot water.

A circulation of liquid through the duct of the air vent screw ensures lubrication and cooling of the shaft seal.

The twin-head pumps are connected in parallel. A non-return flap valve in the common outlet port is opened by the flow of the pumped liquid and prevents backflow of liquid into the idle pump head. The pump housing is provided with a replaceable bronze neck ring to reduce the amount of liquid running from the discharge side of the impeller to the suction side.

The pumps are fitted with high efficiency motors classified as IE3 in accordance with IEC 60034-30. The fan-cooled motors are totally enclosed, with main dimensions to IEC and DIN standards. Electrical tolerances comply with IEC 60034. Insulation class F (IEC 85). These motors show high efficiency, thus minimizing the energy consumption. The motor can be driven via a variable frequency drive for variable speed operation.



10.2 END-SUCTION PUMPS

Low or high head pumps

Non-self-priming, single-stage, centrifugal volute end-suction pumps with axial inlet port, radial outlet port and horizontal shaft, designed according to ISO 5199 with dimensions and rated performance according to EN 733 (10 bar). Flanges are PN 16 with dimensions according to EN 1092-2.

The pump is close-coupled to a fan-cooled asynchronous motor. Pump housing and impeller are made of cast iron, while the wear ring is made of bronze. The back pull-out design enables removal of the motor, motor stool and impeller without disturbing the pump housing or pipework. Cast-iron parts have an epoxy-based coating made in a cathodic electro-deposition (CED) process.

The pump housing has both a priming and a drain hole closed by plugs.

The impeller is a closed impeller with double-curved blades with smooth surfaces. The impeller is statically balanced according to ISO 1940-1 class G6.3 and hydraulically balanced to compensate for axial thrust. Wear rings used in pump housing and for impeller are made of bronze.

Motor stool and pump cover are made of cast iron. Coupling guards are fitted to the motor stool. The pump cover is provided with a manual air vent screw for venting of the pump housing and the shaft seal chamber. An O-ring forms the seal between cover and pump housing.

The pump is fitted with an unbalanced rubber bellows seal with torque transmission across the spring and around the bellows. Due to the bellows, the seal does not wear the shaft, and the axial movement is not prevented by deposits on the shaft.

Primary seal:

- Rotating seal ring material: Silicon carbide (SiC)
- Stationary seat material: Silicon carbide (SiC)

This material pairing is used where higher corrosion resistance is

HYDRONIC GROUP

required. The high hardness of this material pairing offers good resistance against abrasive particles.

Secondary seal material: EPDM (ethylene-propylene rubber). EPDM has excellent resistance to hot water.

The pumps are fitted with high efficiency motors classified as IE3 in accordance with IEC 60034-30. The fan-cooled motors are totally enclosed, with main dimensions to IEC and DIN standards. Electrical tolerances comply with IEC 60034. Insulation class F (IEC 85). These motors show high efficiency, thus minimizing the energy consumption. The motor can be driven via a variable frequency drive for variable speed operation.



10.3 VARIABLE FREQUENCY DRIVE

For pump speed control

Mitsubishi Electric frequency converters, with IP55 protection rating for rough environment. The drives, one for each pump, are cooled by built-in fans and installed with a dedicated enclosure.

The fast-response speed control combined with the advanced auto-tuning function ensures safe and accurate operation in any condition.

Optimum control of the excitation current maximizes motor efficiency for additional energy savings.

The drive features built-in EMC filter (EN 61800-3, 1st Environment, Category C2) and DC link choke to significantly reduce electromagnetic noise and current harmonic distortion THDi.

10.3 OTHER COMPONENTS

The following components are excluded from the hydronic kit supply, but their use is mandatory for the correct unit and system operation.

These components are available as accessories and supplied loose, it shall be the customer responsibility to install them.

- Unit inlet water filter
- Unit outlet flow-switch

It is also recommended the use of the following components:

- Unit inlet and outlet pressure gauges
- Shut-off valves
- Flexible joints on piping



Possible configurations

PUMP GROUP	Versions	
	K	SL-K
HYDRONIC KIT 1 PUMP 2 POLES LH(4706)	X	X
HYDRONIC KIT 1 PUMP 2 POLES HH(4707)	X	X
HYDRONIC KIT 2 PUMPS 2 POLES LH(4711)	X	X
HYDRONIC KIT 2 PUMPS 2 POLES HH(4712)	X	X



HYDRONIC GROUP

UNITA' CON KIT IDRONICO UNITS WITH HYDRONIC GROUP



KIT IDRONICO INTERNO - POMPE IN-LINE INTERNAL HYDRONIC KIT - IN-LINE PUMPS

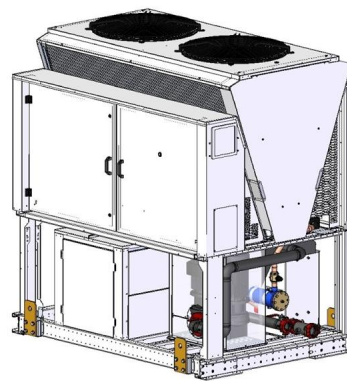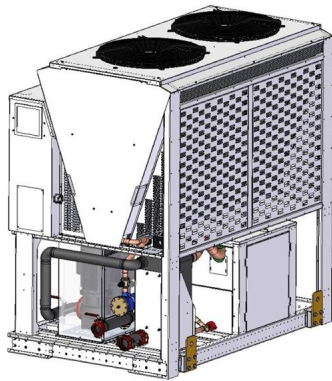

KIT IDRONICO SU PROLUNGAMENTO STRUTTURA - POMPE IN-LINE HYDRONIC KIT ON FRAME EXTENSION - IN-LINE PUMPS

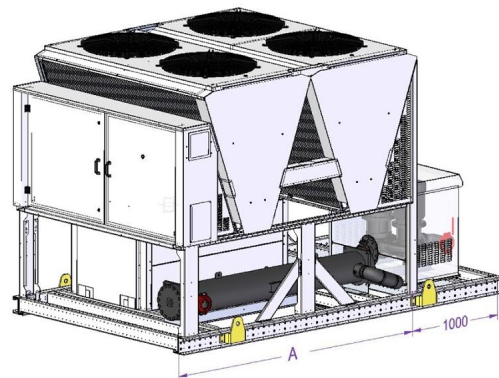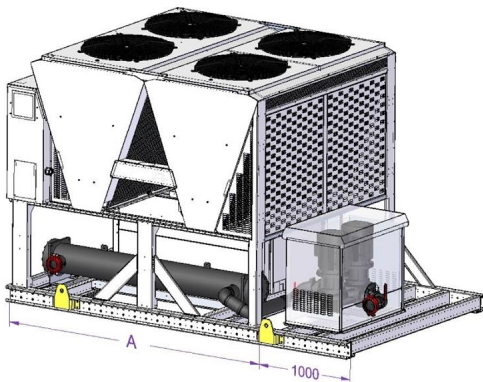


KIT IDRONICO INTERNO - POMPE ORTOGONALI INTERNAL HYDRONIC KIT - END-SUCTION PUMPS

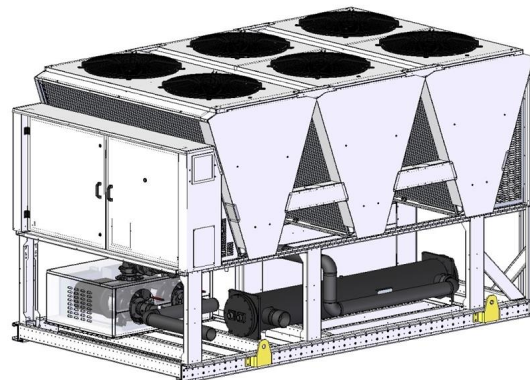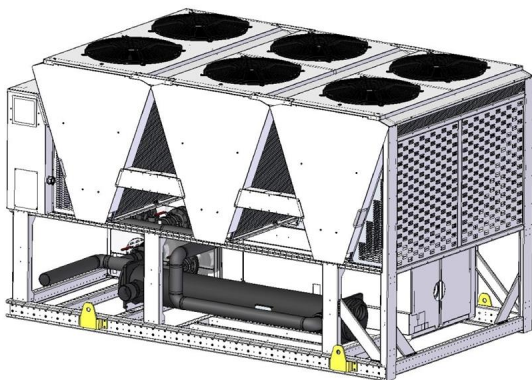

HYDRONIC GROUP


Schema idraulico 1 POMPA IN-LINE o 1 POMPA ORTOGOLALE - configurazione STD
 Hydraulic diagram 1 IN-LINE water PUMP or 1 END-SUCTION water PUMP - STD configuration

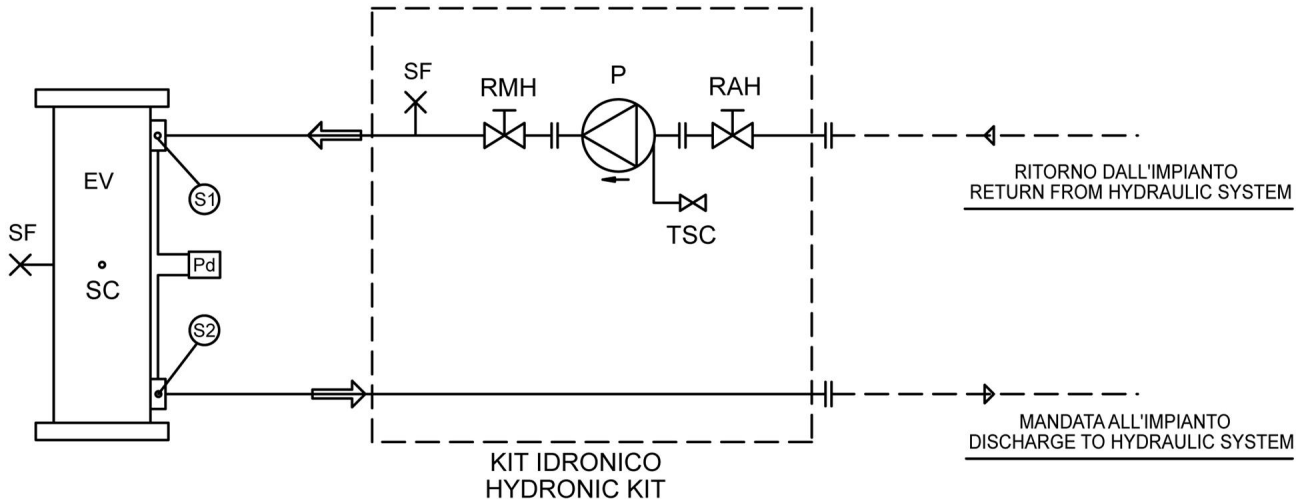

LEGENDA - LEGEND	
<i>COMPONENTI DEL KIT IDRONICO</i> <i>COMPONENTS OF THE HYDRONIC KIT</i>	
EV	Evaporatore (scambiatore a fascio tubiero) Evaporator (tube exchanger)
P	Pompa gemellare Twin rotor pump
Pd	Pressostato differenziale lato acqua Water Differential pressure switch
RAH	Rubinetto aspirazione Pump suction valve
RMH	Rubinetto mandata Pump discharge valve
SC	Valvola di scarico Drain valve
TSC	Tappo di scarico Drain plug
SF	Valvola di sfiato Purge valve
S1	Sonda ingresso acqua scambiatore Exchanger water inlet probe
S2	Sonda uscita acqua scambiatore Exchanger water outlet probe
VR	Valvola di non ritorno (interna alla pompa) One way valve (pump inside)

HYDRONIC GROUP


Schema idraulico 2 POMPE IN-LINE - configurazione STD
 Hydraulic diagram 2 IN-LINE water PUMPS - STD configuration

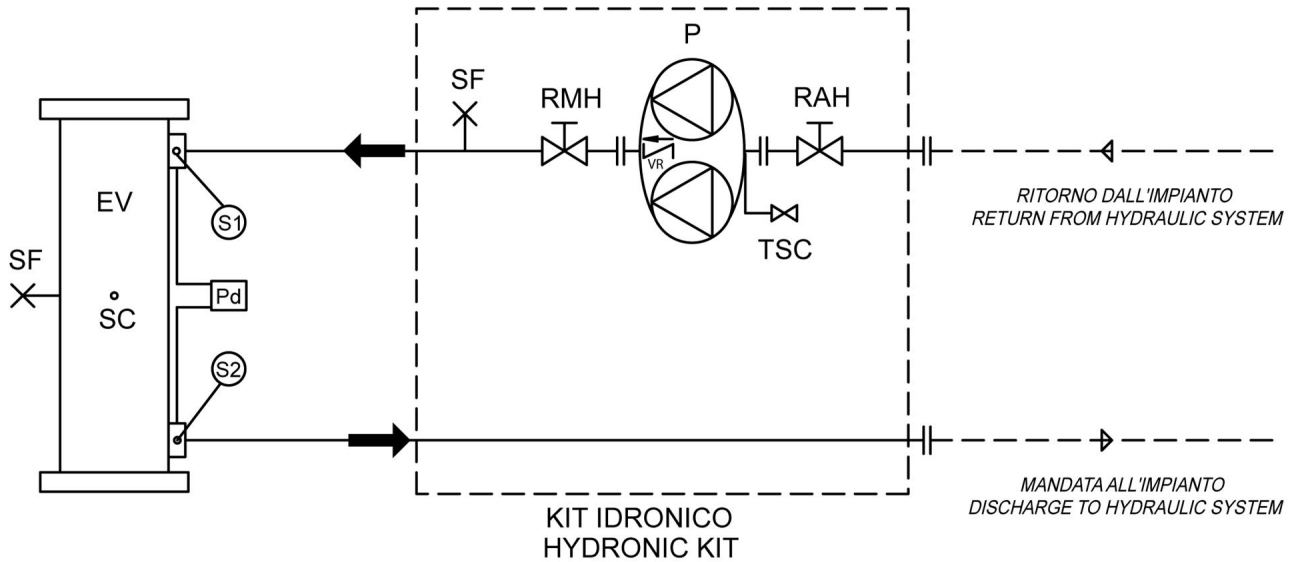

LEGENDA - LEGEND	
<i>COMPONENTI DEL KIT IDRONICO</i> <i>COMPONENTS OF THE HYDRONIC KIT</i>	
EV	Evaporatore (scambiatore a fascio tubiero) Evaporator (tube exchanger)
P	Pompa gemellare Twin rotor pump
Pd	Pressostato differenziale lato acqua Water Differential pressure switch
RAH	Rubinetto aspirazione Pump suction valve
RMH	Rubinetto mandata Pump discharge valve
SC	Valvola di scarico Drain valve
TSC	Tappo di scarico Drain plug
SF	Valvola di sfiato Purge valve
S1	Sonda ingresso acqua scambiatore Exchanger water inlet probe
S2	Sonda uscita acqua scambiatore Exchanger water outlet probe
VR	Valvola di non ritorno (interna alla pompa) One way valve (pump inside)

HYDRONIC GROUP

Schema idraulico 2 POMPE ORTOGOLALI - configurazione STD
 Hydraulic diagram 2 END-SUCTION water PUMPS - STD configuration

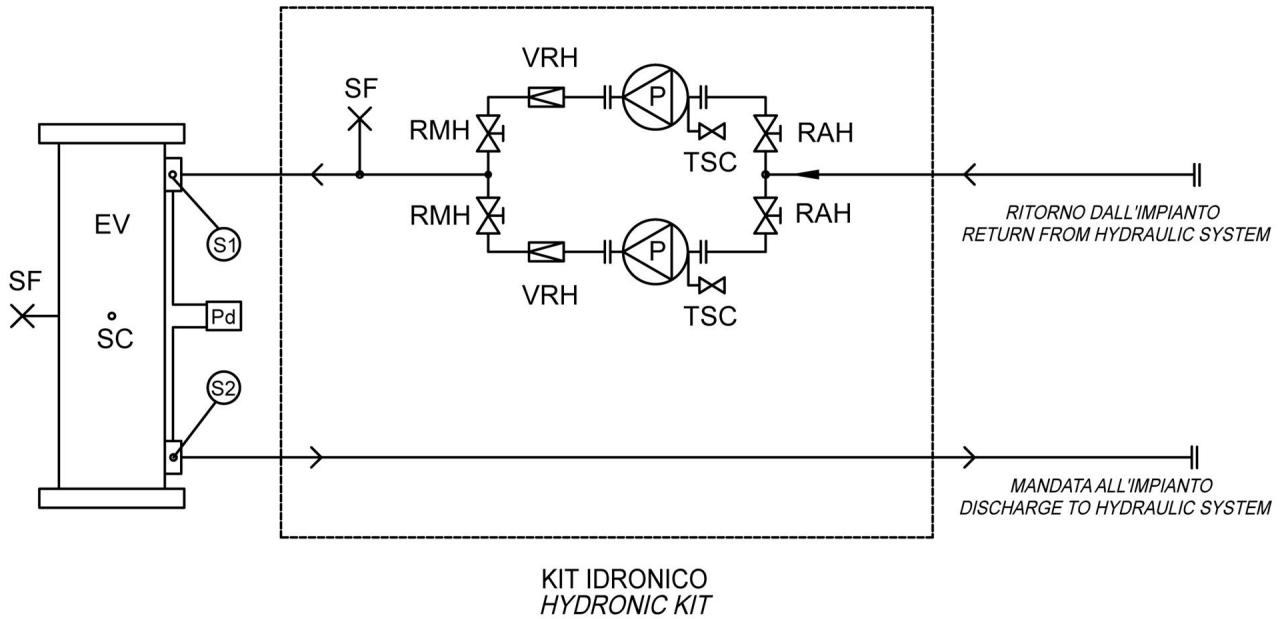

LEGENDA - LEGEND

COMPONENTI DEL KIT IDRONICO
COMPONENTS OF THE HYDRONIC KIT

EV	Evaporatore (scambiatore a fascio tubiero) Evaporator (tube exchanger)
P	Pompa Water pump
Pd	Pressostato differenziale lato acqua Water Differential pressure switch
RAH	Rubinetto aspirazione Pump suction valve
RMH	Rubinetto mandata Pump discharge valve
SC	Valvola di scarico Drain valve
TSC	Tappo di scarico Drain plug
SF	Valvola di sfiato Purge valve
S1	Sonda ingresso acqua scambiatore Exchanger water inlet probe
S2	Sonda uscita acqua scambiatore Exchanger water outlet probe
VRH	Valvola di non ritorno One way valve

HYDRONIC GROUP

Hydronic kit positioning

	Version	HYDRONIC KIT 1 PUMP 2 POLES LH (4706)				HYDRONIC KIT 1 PUMP 2 POLES HH (4707)				HYDRONIC KIT 2 PUMPS 2 POLES LH (4711)				HYDRONIC KIT 2 PUMPS 2 POLES HH (4712)			
		extra L [mm]	extra W [mm]	extra H [mm]	extra WGT [kg]	extra L [mm]	extra W [mm]	extra H [mm]	extra WGT [kg]	extra L [mm]	extra W [mm]	extra H [mm]	extra WGT [kg]	extra L [mm]	extra W [mm]	extra H [mm]	extra WGT [kg]
0751	K	/	/	/	-	/	/	/	-	/	/	/	-	/	/	/	-
	SL-K	/	/	/	-	/	/	/	-	/	/	/	-	/	/	/	-
0851	K	/	/	/	-	/	/	/	-	/	/	/	-	/	/	/	-
	SL-K	/	/	/	-	/	/	/	-	/	/	/	-	/	/	/	-
0951	K	1000	/	/	-	1000	/	/	-	1000	/	/	-	1000	/	/	-
	SL-K	1000	/	/	-	1000	/	/	-	1000	/	/	-	1000	/	/	-
0961	K	1000	/	/	-	1000	/	/	-	1000	/	/	-	1000	/	/	-
	SL-K	1000	/	/	-	1000	/	/	-	1000	/	/	-	1000	/	/	-
1101	K	1000	/	/	-	1000	/	/	-	1000	/	/	-	1000	/	/	-
	SL-K	1000	/	/	-	1000	/	/	-	1000	/	/	-	1000	/	/	-
1301	K	1000	/	/	-	1000	/	/	-	1000	/	/	-	1000	/	/	-
	SL-K	1000	/	/	-	1000	/	/	-	1000	/	/	-	1000	/	/	-
1401	K	1000	/	/	-	1000	/	/	-	1000	/	/	-	1000	/	/	-
	SL-K	1000	/	/	-	1000	/	/	-	1000	/	/	-	1000	/	/	-
1421	K	1000	/	/	-	1000	/	/	-	1000	/	/	-	1000	/	/	-
	SL-K	1000	/	/	-	1000	/	/	-	1000	/	/	-	1000	/	/	-
1431	K	1000	/	/	-	1000	/	/	-	1000	/	/	-	1000	/	/	-
	SL-K	1000	/	/	-	1000	/	/	-	1000	/	/	-	1000	/	/	-
1801	K	1000	/	/	-	1000	/	/	-	1000	/	/	-	1000	/	/	-
	SL-K	1000	/	/	-	1000	/	/	-	1000	/	/	-	1000	/	/	-

- extra L** Unit's extra length
- extra W** Unit's extra operating width (NOT to be considered for transport)
- extra H** Unit's extra height
- extra H** Unit's extra weight (pumps and piping)
- HYDRONIC KIT 1 PUMP 2 POLES LH** HYDRONIC KIT 1 PUMP 2 POLES LH
- HYDRONIC KIT 1 PUMP 2 POLES HH** HYDRONIC KIT 1 PUMP 2 POLES HH
- HYDRONIC KIT 2 PUMPS 2 POLES LH** HYDRONIC KIT 2 PUMPS 2 POLES LH
- HYDRONIC KIT 2 PUMPS 2 POLES HH** HYDRONIC KIT 2 PUMPS 2 POLES HH
- Not available

HYDRONIC GROUP

HEAT EXCHANGER USER SIDE - HYDRONIC KIT 1 PUMP 2 POLES HH

SIZE		CH		PUMP					CH
		Pfgross	Qfgross	Rif.	Model	N.	F.L.A.	F.L.I.	HU
		[kW] (1)	[l/s] (1)			Pole	[A]	[kW]	[kPa]
0751	K	145,5	6,957	A1	TP 50-290/2	2	6	3,000	218
	SL-K	140,1	6,698						224
0851	K	160,1	7,654	B1	TP 65-250/2	2	8	4,000	217
	SL-K	169,5	8,107						212
0951	K	202,8	9,696	B2	TP 65-250/2	2	8	4,000	199
	SL-K	195,5	9,351						203
0961	K	221,9	10,61	C1	TP 65-340/2 IE3	2	11	5,500	261
	SL-K	214,7	10,27						266
1101	K	238,0	11,38	C2	TP 65-340/2 IE3	2	11	5,500	248
	SL-K	245,9	11,76						242
1301	K	274,7	13,14	D1	TP 80-240/2	2	11	5,500	171
	SL-K	265,0	12,67						176
1401	K	299,1	14,30	D2	TP 80-240/2	2	11	5,500	158
	SL-K	287,8	13,76						164
1421	K	329,0	15,73	E1	TP 80-250/2	2	14	7,500	198
	SL-K	331,8	15,86						196
1431	K	347,7	16,63	E2	TP 80-250/2	2	14	7,500	210
	SL-K	346,5	16,57						210
1801	K	395,7	18,92	F1	TP 80-330/2	2	21	11,00	225
	SL-K	395,0	18,89						225

(1) Values refer to nominal conditions

CH Cooling mode

Pf Cooling capacity unit (Cooling mode)

Pt Heating capacity unit (Heating mode)


Q Plant (side) exchanger water flow

F.L.I. Pump power input

F.L.A. Pump running current

HU Pump residual pressure head (Units with hydronic group without mains filter)

HEAT EXCHANGER USER SIDE - HYDRONIC KIT 1 PUMP 2 POLES HH

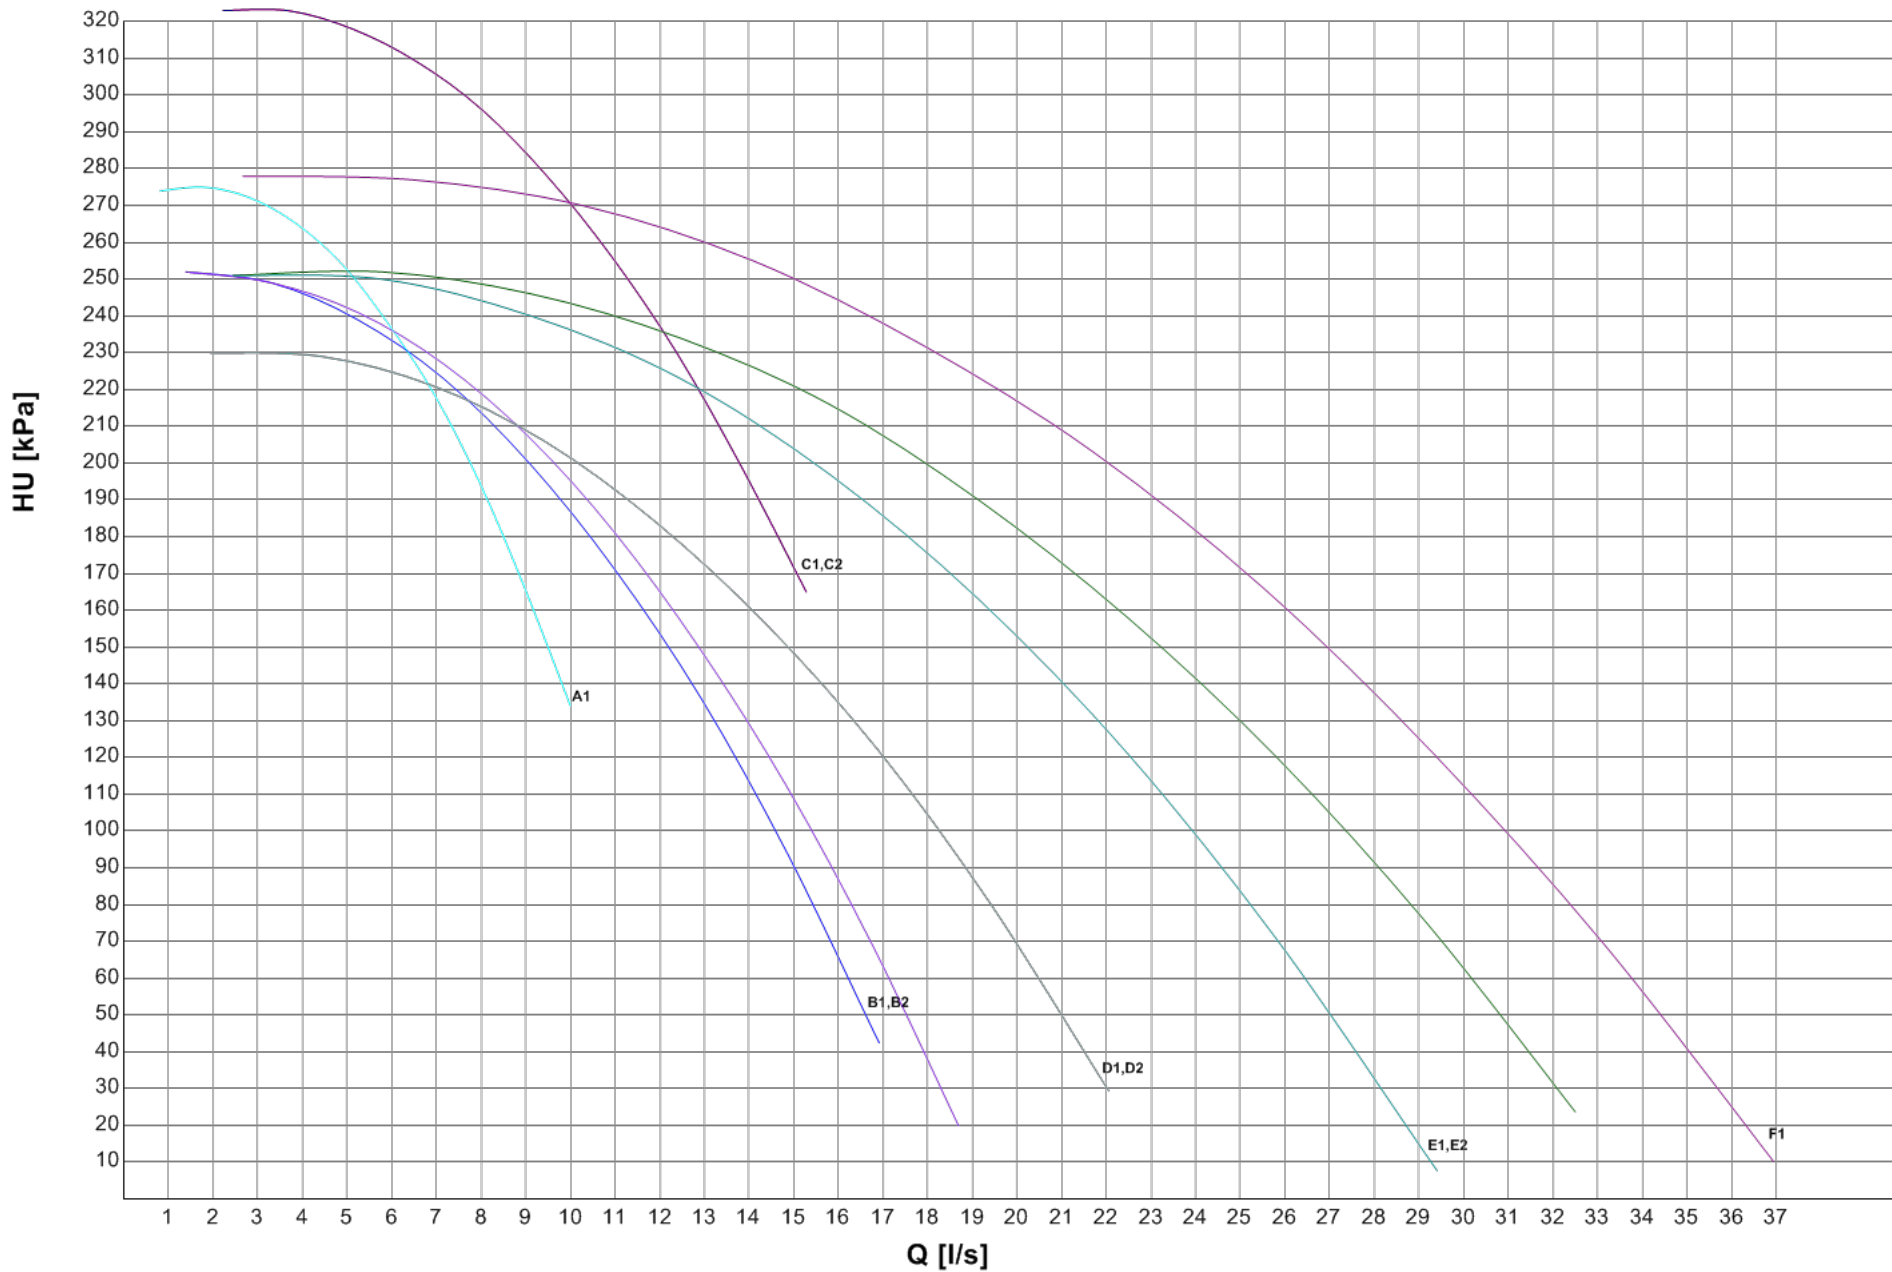

HYDRONIC GROUP

HEAT EXCHANGER USER SIDE - HYDRONIC KIT 1 PUMP 2 POLES LH

SIZE		CH		PUMP					CH	
		Pfgross	Qfgross	Rif.	Model	N.	F.L.A.	F.L.I.	HU	
		[kW] (1)	[l/s] (1)			Pole	[A]	[kW]	[kPa]	
0751	K	145,5	6,957	A1	TP 65-170/2	2	4	2,200	136	
	SL-K	140,1	6,698						139	
0851	K	160,1	7,654	A2					132	
	SL-K	169,5	8,107						127	
0951	K	202,8	9,696	A3					111	
	SL-K	195,5	9,351						116	
0961	K	221,9	10,61	B1		TP 80-210/2	2	8	4,000	147
	SL-K	214,7	10,27							151
1101	K	238,0	11,38	B2						139
	SL-K	245,9	11,76							135
1301	K	274,7	13,14	B3						130
	SL-K	265,0	12,67							135
1401	K	299,1	14,30	B4	115					
	SL-K	287,8	13,76		122					
1421	K	329,0	15,73	B5	120					
	SL-K	331,8	15,86		118					
1431	K	347,7	16,63	B6	129					
	SL-K	346,5	16,57		130					
1801	K	395,7	18,92	C1	TP 100-200/2	2	11	5,500	140	
	SL-K	395,0	18,89						140	


(1) Values refer to nominal conditions
 CH Cooling mode
 Pf Cooling capacity unit (Cooling mode)
 Pt Heating capacity unit (Heating mode)

Q Plant (side) exchanger water flow
 F.L.I. Pump power input
 F.L.A. Pump running current
 HU Pump residual pressure head (Units with hydronic group without mains filter)



HEAT EXCHANGER USER SIDE - HYDRONIC KIT 1 PUMP 2 POLES LH

HYDRONIC GROUP

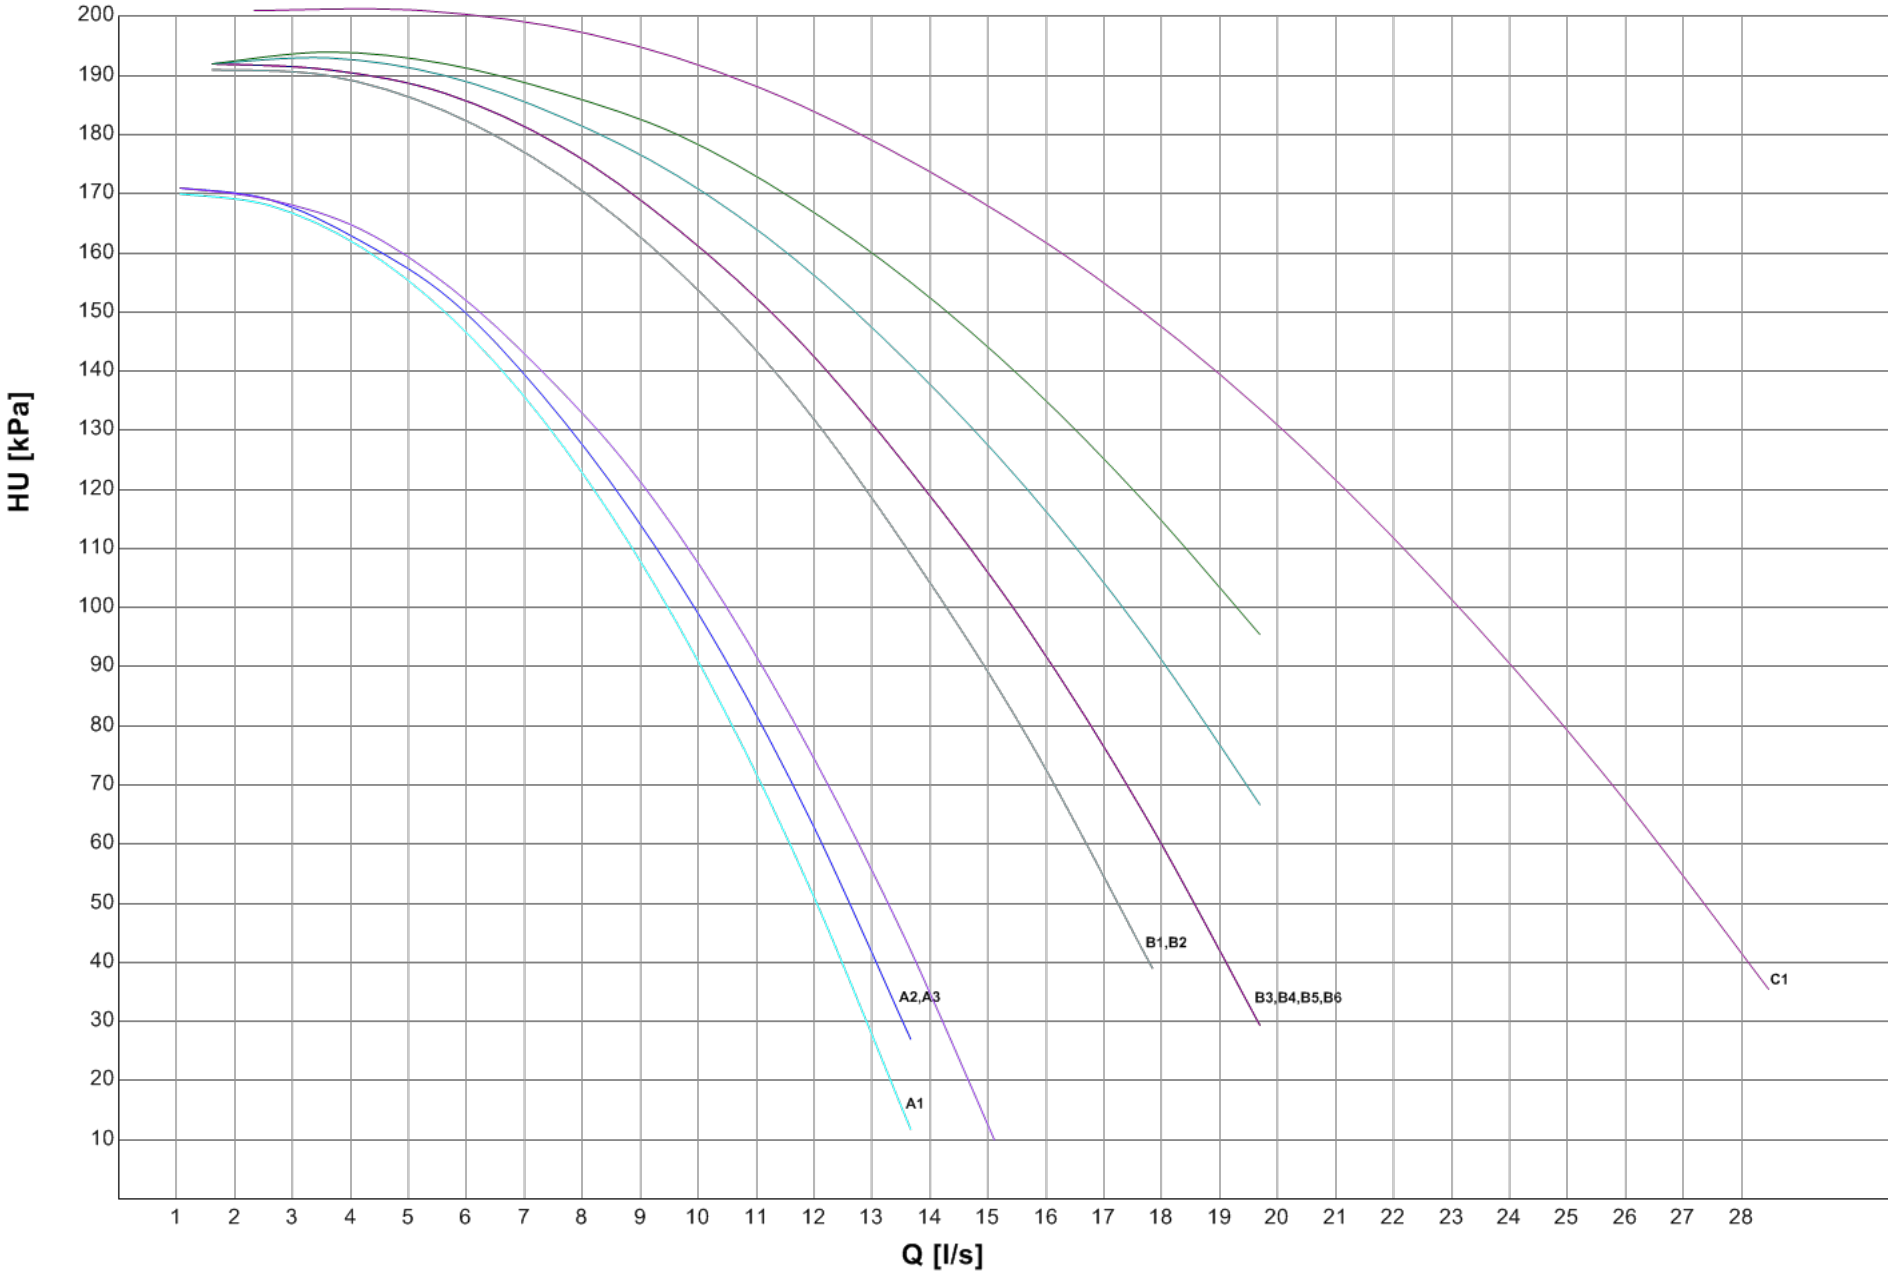

HYDRONIC GROUP

HEAT EXCHANGER USER SIDE - HYDRONIC KIT 2 PUMPS 2 POLES HH

SIZE		CH		PUMP					CH
		Pfgross	Qfgross	Rif.	Model	N.	F.L.A.	F.L.I.	HU
		[kW] (1)	[l/s] (1)			Pole	[A]	[kW]	[kPa]
0751	K	145,5	6,957	A1	TPD 50-290/2	2	6	3,000	193
	SL-K	140,1	6,698						199
0851	K	160,1	7,654	B1	TPD 65-250/2	2	8	4,000	208
	SL-K	169,5	8,107						202
0951	K	202,8	9,696	B2	TPD 65-250/2	2	8	4,000	186
	SL-K	195,5	9,351						191
0961	K	221,9	10,61	C1	TPD 65-340/2 IE3	2	11	5,500	249
	SL-K	214,7	10,27						255
1101	K	238,0	11,38	C2	TPD 65-340/2 IE3	2	11	5,500	234
	SL-K	245,9	11,76						226
1301	K	274,7	13,14	D1	TPD 80-240/2	2	11	5,500	166
	SL-K	265,0	12,67						172
1401	K	299,1	14,30	D2	TPD 80-240/2	2	11	5,500	151
	SL-K	287,8	13,76						158
1421	K	329,0	15,73	E1	TPD 80-250/2 IE3	2	14	7,500	185
	SL-K	331,8	15,86						184
1431	K	347,7	16,63	E2	TPD 80-250/2 IE3	2	14	7,500	196
	SL-K	346,5	16,57						197
1801	K	395,7	18,92	F1	TPD80-330/2 IE3	2	21	11,00	226
	SL-K	395,0	18,89						226

(1) Values refer to nominal conditions

CH Cooling mode

Pf Cooling capacity unit (Cooling mode)

Pt Heating capacity unit (Heating mode)


Q Plant (side) exchanger water flow

F.L.I. Pump power input

F.L.A. Pump running current

HU Pump residual pressure head (Units with hydronic group without mains filter)

HEAT EXCHANGER USER SIDE - HYDRONIC KIT 2 PUMPS 2 POLES HH

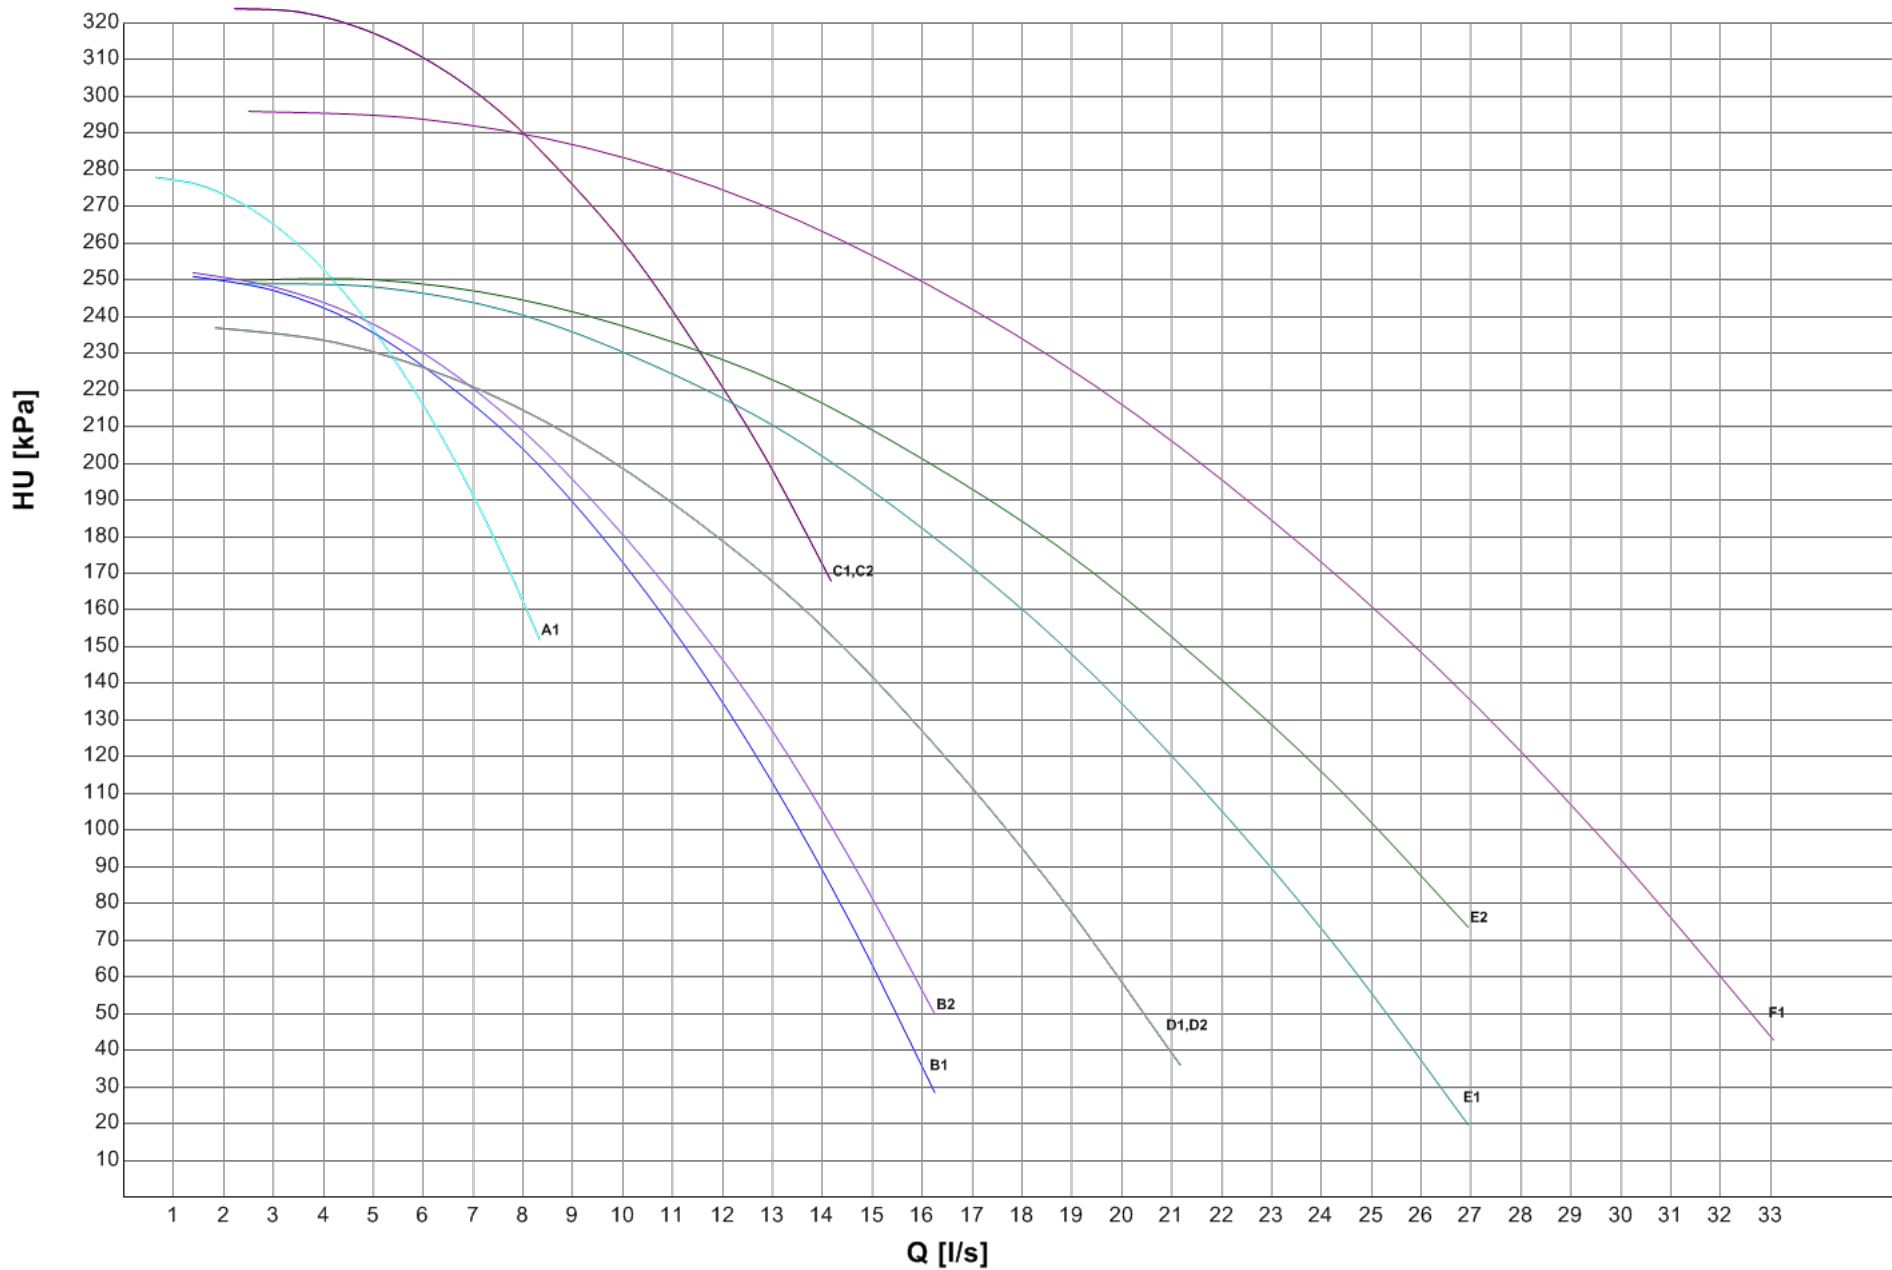

HYDRONIC GROUP


HEAT EXCHANGER USER SIDE - HYDRONIC KIT 2 PUMPS 2 POLES LH

SIZE		CH		PUMP					CH	
		Pfgross	Qfgross	Rif.	Model	N.	F.L.A.	F.L.I.	HU	
		[kW] (1)	[l/s] (1)			Pole	[A]	[kW]	[kPa]	
0751	K	145,5	6,957	A1	TPD 65-170/2	2	21	10,20	128	
	SL-K	140,1	6,698						132	
0851	K	160,1	7,654	A2					123	
	SL-K	169,5	8,107						116	
0951	K	202,8	9,696	A3					97,7	
	SL-K	195,5	9,351						103	
0961	K	221,9	10,61	B1		TPD 80-210/2 IE3	2	8	4,000	139
	SL-K	214,7	10,27							142
1101	K	238,0	11,38	B2						129
	SL-K	245,9	11,76							124
1301	K	274,7	13,14	B3						118
	SL-K	265,0	12,67							124
1401	K	299,1	14,30	B4	103					
	SL-K	287,8	13,76		110					
1421	K	329,0	15,73	B5	105					
	SL-K	331,8	15,86		104					
1431	K	347,7	16,63	B6	114					
	SL-K	346,5	16,57		115					
1801	K	395,7	18,92	C1	TPD 100-200/2 IE3		2	11	5,500	126
	SL-K	395,0	18,89							126

(1) Values refer to nominal conditions
 CH Cooling mode
 Pf Cooling capacity unit (Cooling mode)
 Pt Heating capacity unit (Heating mode)

Q Plant (side) exchanger water flow
 F.L.I. Pump power input
 F.L.A. Pump running current
 HU Pump residual pressure head (Units with hydronic group without mains filter)

HEAT EXCHANGER USER SIDE - HYDRONIC KIT 2 PUMPS 2 POLES LH

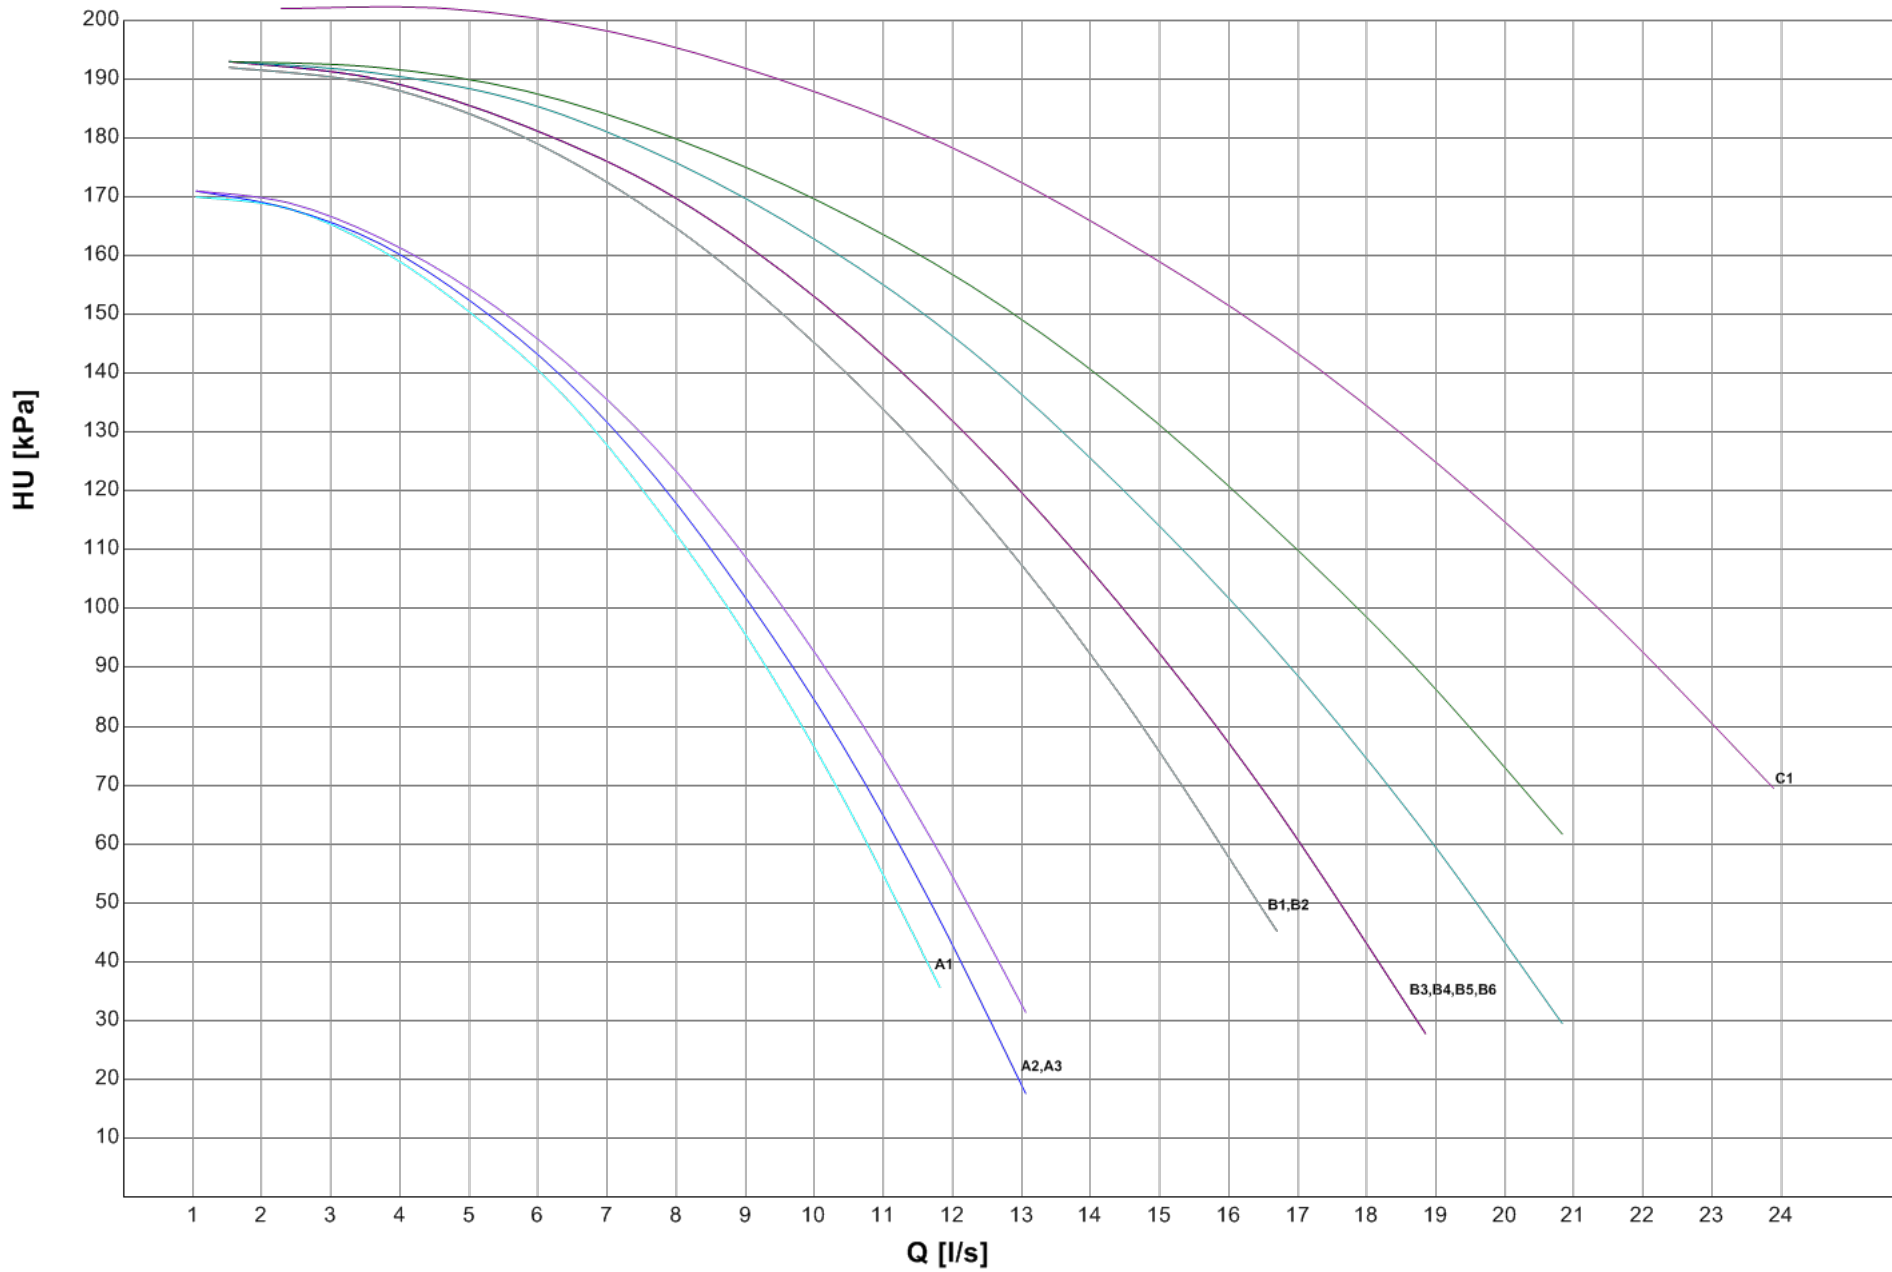

VARIABLE FLOW CONTROL

Pump energy consumption significantly impacts plant running costs, but it can be considerably reduced thanks to the use of variable speed pumps (inverter driven pumps), capable of adjusting the water flow rate according to the actual plant thermal load.

Mitsubishi Electric Hydronics & Cooling Systems has developed the VPF control series (Variable Primary Flow), that provides different water flow regulation logics specifically devoted to various hydraulic

plant solutions: only a primary circuit, primary and secondary circuits, single unit or multi-unit systems.

The VPF systems adjust the pump speeds on the basis of the plant's thermal load and optimize the unit's thermoregulation algorithm for variable flow operation, in a dynamic and simultaneous way. This ensures the highest energy savings, stable operation, and complete reliability.

VPF SYSTEM (delta P control)


For plants with only a primary circuit

VPF - Plant and unit requirements


The VPF logic provides the variable flow control for the plant's primary circuit.

- Type of plant: primary circuit only, that feeds hydronic terminals fitted with a 2-way regulating valve
- Hydronic module: modulating regulation devices (0-10V signal) or variable speed pumps
- Unit thermoregulation: control of the leaving water temperature
- Monitored parameter: delta P on relevant users' hydronic terminal

Plant diagram for single unit system

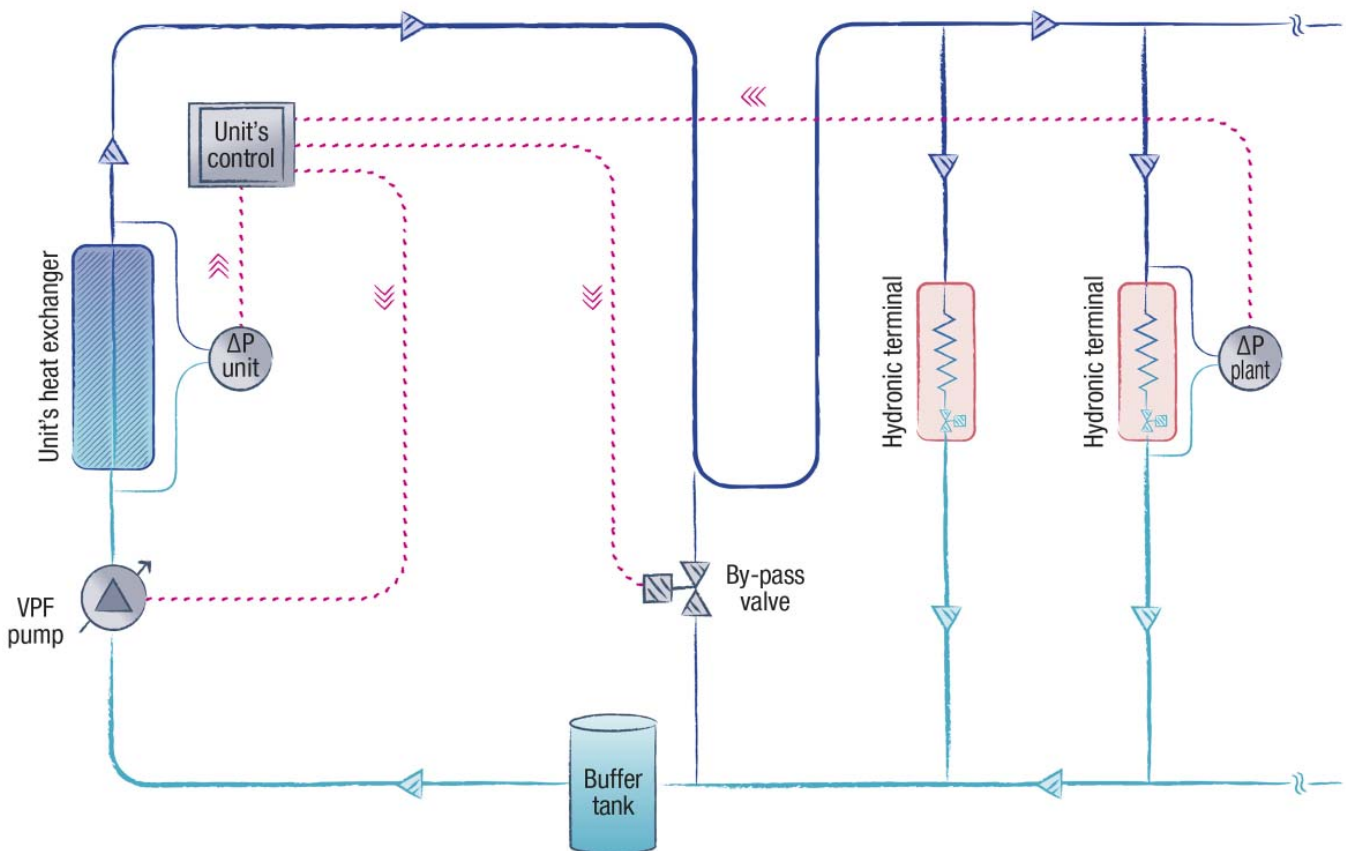

Plant diagram for multi-unit system

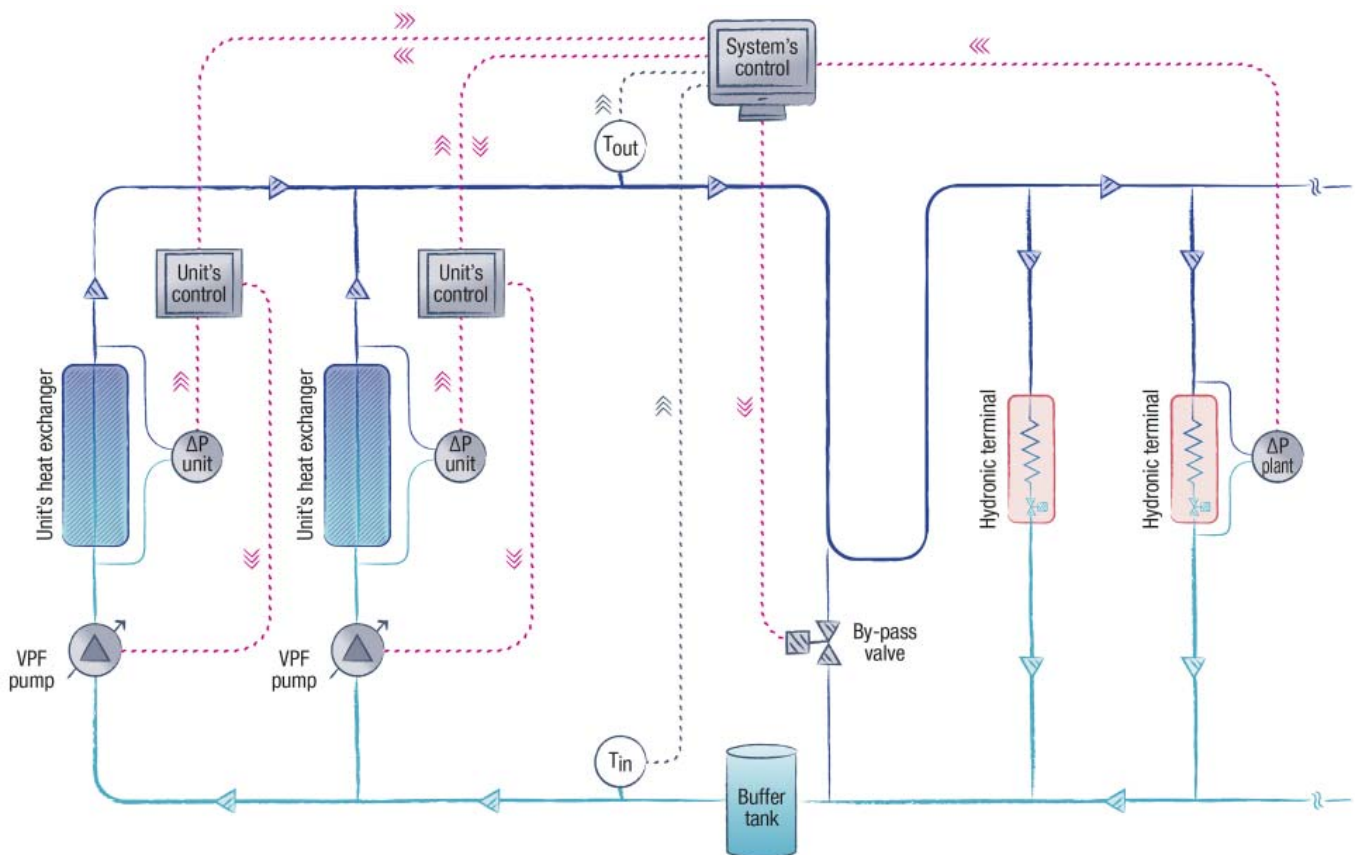

VPF - Operating logic

Water flow regulation

The VPF system monitors the differential pressure on the plant side (ΔP) and adjusts the pump speed in order to keep it within a defined range ($\Delta P_{min} \leftrightarrow \Delta P_{max}$).

- If $\Delta P_{min} \leq \Delta P \leq \Delta P_{max}$
The plant water flow is appropriate to the thermal load, the pump speed is kept constant.
- If $\Delta P > \Delta P_{max}$
The plant water flow exceeds what is necessary to properly cover the thermal load, the pump speed is reduced to save pump energy.
- If $\Delta P < \Delta P_{min}$
The plant water flow is too low to ensure the proper feed to the hydronic terminals, the pump speed is increased.

With the VPF system, the water flow can be reduced to 50% of the unit nominal water flow, with regards to the selection conditions, provided that the minimum water flow required by the unit's heat exchanger is respected (the control of the heat exchanger's minimum water flow is described below).

The pump speed regulation is performed with little progressive adjustments while continuously monitoring the values of both the delta P on the plant side and the water temperature on the heat exchanger. The absence of abrupt water flow changes prevents fluctuation due to possible conflicts with the unit's thermoregulation function (compressor regulation).

Control of the unit's minimum water flow

Under no circumstances can the primary circuit water flow be reduced below the minimum water flow required by the unit's heat exchanger. The monitoring of the unit's water flow is performed through a factory installed differential pressure transducer on the unit's heat exchanger. If the differential pressure on the plant side requests a user's water flow lower than the unit's minimum water flow, the VPF system commands the gradual opening of the hydraulic by-pass valve (safety function). This ensures that the minimum water flow required by the unit's heat exchanger is always provided. As soon as the hydronic terminals request an increase of the water flow ($\Delta P < \Delta P_{min}$), the VPF closes the by-pass valve.

Multi-unit systems

The VPF control logic is also the same for multi-unit systems. The plant side differential pressure transducer reading and the by-pass valve opening are managed by the multi-unit control system (Manager3000 or ClimaPRO). Each unit autonomously adjusts its pump speed on the basis of the information provided by the multi-unit control system. When the plant load requests the activation of a stand-by unit, the multi-unit control system calculates the starting speed of its pump in order to avoid excessive water flow variation of the running units.

VPF - Devices and installation

Device	Accessory name		
	VPF (plant DP trans excl)	VPF (plant DP trans incl)	VPF MULTI-UNIT SYSTEM
Differential pressure transducer on the unit's heat exchanger and related controller expansion board	Factory installed	Factory installed	Factory installed
Controller expansion board to read the plant side differential pressure transducer (4-20mA signal) and manage the hydraulic by-pass valve opening (0-10V signal)	Factory installed	Factory installed	Factory installed on the multi-unit control system ⁽²⁾
Plant side differential pressure transducer	Not included (the supply is the customer's responsibility) ⁽¹⁾	Factory supplied, installation is the client's responsibility ⁽¹⁾⁽²⁾	Factory supplied with the multi-unit control system, installation is the client's responsibility ⁽¹⁾⁽³⁾
Plant side hydraulic by-pass valve	Not included (the supply is the customer's responsibility) ⁽⁴⁾	Not included (the supply is the customer's responsibility) ⁽⁴⁾	Not included (the supply is the customer's responsibility) ⁽⁴⁾

- (1) It is recommended to install the differential pressure transducer on the most hydraulically critical hydronic terminal, to ensure it has a proper water flow in any load condition.
- (2) Technical features of the differential pressure transducer supplied:
 Model: Huba Control 692.9 120071C1
 Pressure range: 0 ... + 1 bar
 Output: 4-20mA
 Electrical connection: DIN EN 175301-803-A (IP 65)
 Pressure connection adapters: male threaded G 1/8"
- (3) It is the customer's responsibility to configure the multi-unit control system (Manager3000 or ClimaPRO) with option VPF.
- (4) See attached table for information on the hydraulic by-pass design.

The following table provides the indications for a correct hydraulic by-pass design.

Heat exchanger minimum flow (m ³ /h) ⁽¹⁾	Minimum by-pass diameter	Minimum by-pass valve diameter	Suggested valve model	Kvs	Suggested actuator model
From 19 to 30	DN50 (2")	DN50 (2")	VVG41.50	40	SKB60
Up to 37	DN65 (2" ½)	DN65 (2" ½)	VVF31.65	49	SKB60
Up to 60	DN80 (3")	DN80 (3")	VVF31.80	78	SKB60
Up to 95	DN100 (4")	DN100 (4")	VVF31.90	124	SKC60
Up to 150	DN125 (5")	DN125 (5")	VVF31.91	200	SKC60
Up to 230	DN150 (6")	DN150 (6")	VVF31.92	300	SKC60

- (1) In case of a multi-unit system, the unit with the highest minimum water flow should be the reference.

VPF.D SYSTEM (delta T control)


For plants with primary and secondary circuits separated by a hydraulic decoupler.

VPF.D - Plant and unit requirements


The VPF.D logic provides the variable flow control for the plant's primary circuit.

- Type of plant: primary and secondary circuits separated by a hydraulic decoupler
- Hydronic module: modulating regulation devices (0-10V signal) or variable speed pumps
- Unit thermoregulation: control of the leaving water temperature
- Monitored parameter: delta T on primary circuit

Plant diagram for single unit system

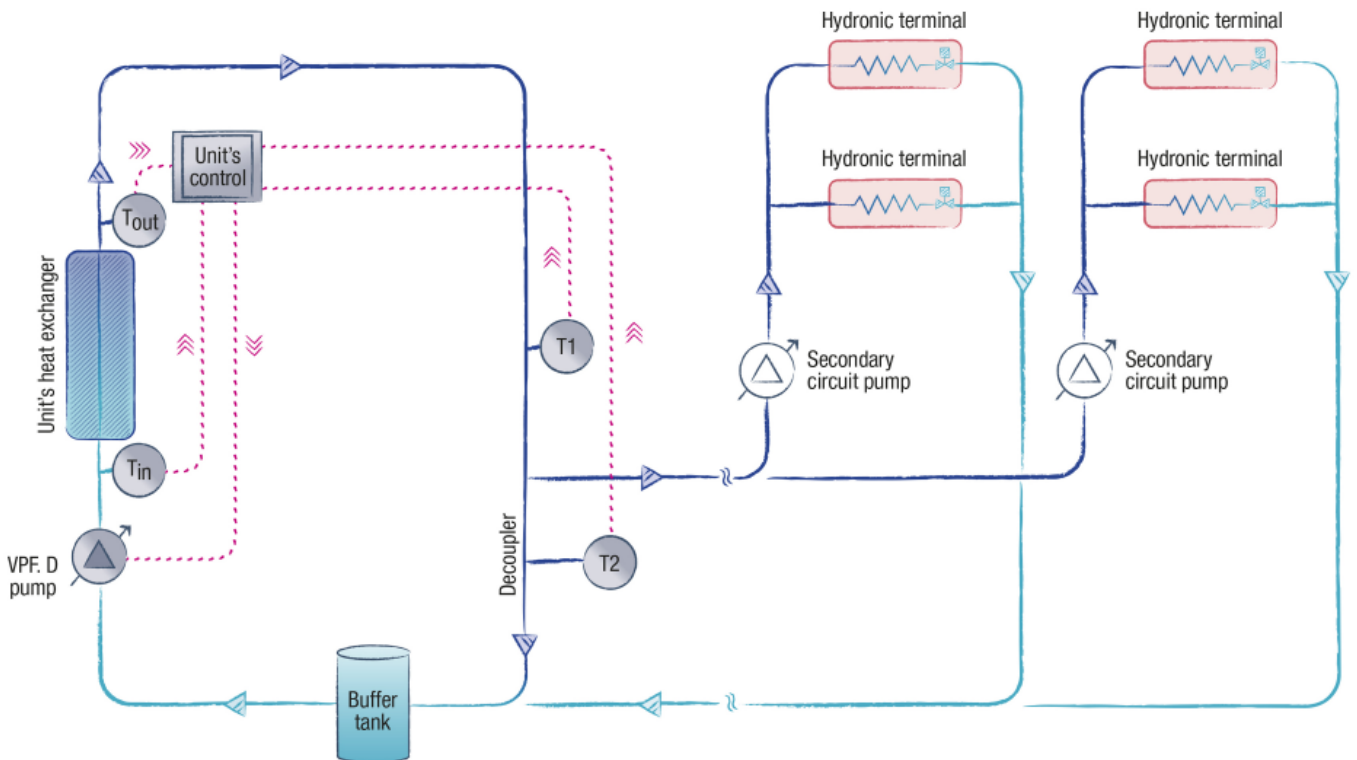

Plant diagram for multi-unit system

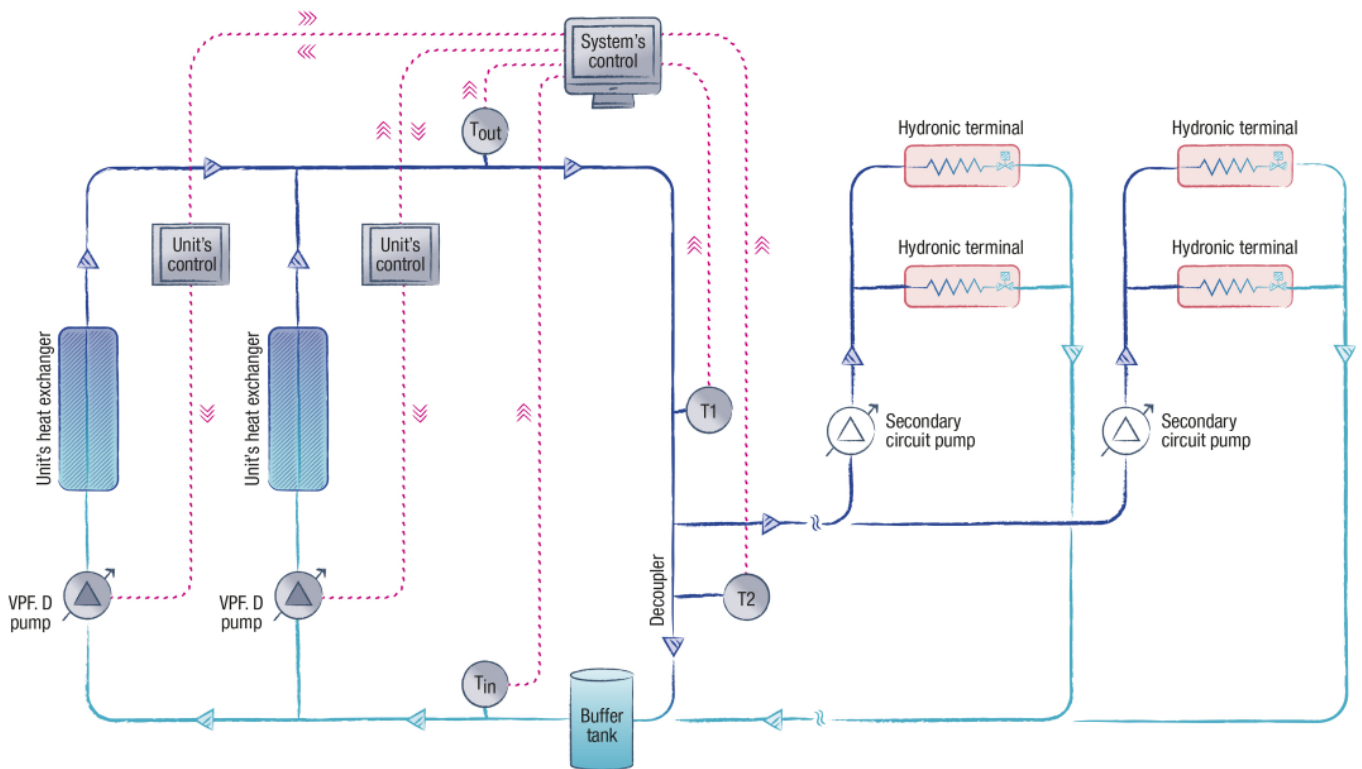

VPF.D - Operating logic

Water flow regulation

The VPF.D system monitors the temperature difference of the primary circuit (ΔT) (that corresponds to the temperature difference of the unit's heat exchanger in the case of a single unit system), and adjusts the primary circuit's pump speed in order to keep it within a defined range ($\Delta T_{min} \leftrightarrow \Delta T_{max}$). The secondary circuit water flow is completely independent and is to be managed by the client.

- If $\Delta T_{min} \leq \Delta T \leq \Delta T_{max}$
The plant water flow is appropriate to the thermal load, the pump speed is kept constant.
- If $\Delta T < \Delta T_{min}$
The plant water flow exceeds what is necessary to properly cover the thermal load, the pump speed is reduced to save pump energy.
- If $\Delta T > \Delta T_{max}$
The plant water flow is too low to ensure the proper feed to the users, the pump speed is increased.

To prevent the returning water of the secondary circuit from recirculating through the decoupler and mixing with the delivery water, which would cause serious plant regulation problems, the VPF.D provides a safety function based on the temperatures, which are detected by two probes on the plant side: T1 on the unit delivery line and T2 on the hydraulic decoupler. If during the water flow regulation of the circuits, the flow direction in the decoupler reverses (detected temperatures $T1 < T2$), the system forces a quick increase of the primary water flow until the correct direction of the flow in the decoupler is restored (detected temperatures $T1 = T2$).

With the VPF.D system, the water flow can be reduced to 50% of the unit nominal water flow, with regards to the selection conditions, provided that the minimum water flow required by the unit's heat exchanger is respected (the control of the heat exchanger's minimum water flow is described below).

The pump speed regulation is performed with little progressive adjustments while continuously monitoring the values of both the temperature difference on the primary circuit and the temperatures of the probes T1 and T2. The absence of abrupt water flow changes prevents fluctuation due to possible conflicts with the unit's thermoregulation function (compressor regulation).

Control of the unit's minimum water flow

Under no circumstances can the primary circuit water flow be reduced below the minimum water flow required by the unit's heat exchanger. The unit's minimum water flow is ensured by setting the minimum pump speed (service menu parameter).

Multi-unit systems

The VPF.D control logic is also the same for multi-unit systems. The reading of the temperature difference on the primary circuit and the reading of the temperature probes T1 and T2 is managed by the multi-unit control system (Manager3000 or ClimaPRO). Each unit autonomously adjusts its pump speed on the basis of the information provided by the multi-unit control system. When the plant load requests the activation of a stand-by unit, the multi-unit control system calculates the starting speed of its pump in order to avoid excessive water flow variation of the running units.

VPF.D - Devices and installation

Device	Accessory name	
	VPF.D	VPF.D MULTI-UNIT SYSTEM
2 plant side NTC temperature sensors and related controller expansion board	Factory supplied (probes supplied without wells), installation is the client's responsibility ⁽¹⁾	Factory supplied with the multi-unit control system (probes supplied without wells), installation is the client's responsibility ⁽¹⁾⁽²⁾

(1) It is recommended to install the temperature probes as shown in the enclosed plant diagrams (T1 on the unit delivery line, T2 on the hydraulic decoupler)

(2) It is the customer's responsibility to configure the multi-unit control system (Manager3000 or ClimaPRO) with option VPF.D.

The following table provides the indications for a correct hydraulic decoupler design.

Heat exchanger minimum flow (m ³ /h) ⁽¹⁾	Minimum hydraulic decoupler diameter
From 25 to 40	DN65 (2" ½)
Up to 60	DN80 (3")
Up to 100	DN100 (4")
Up to 150	DN125 (5")
Up to 225	DN150 (6")
Up to 375	DN200 (8")

(2) In case of a multi-unit system, the unit with the highest minimum water flow should be the reference.



for a greener tomorrow

Eco Changes is the Mitsubishi Electric Group's environmental statement, and expresses the Group's stance on environmental management. Through a wide range of businesses, we are helping contribute to the realization of a sustainable society.



MITSUBISHI ELECTRIC HYDRONICS & IT COOLING SYSTEMS S.p.A.

Head Office: Via Roma 5 • 27010 Valle Salimbene (PV) • Italy
Ph. (+39) (0) 382 433 811 • Fax (+39) (0) 382 587148

www.rcitcooling.com
www.melcohit.com